



2023 ANNUAL COMPLIANCE REPORT

On Public Water Systems

Issued September 3, 2024

New Jersey Department of Environmental Protection
Division of Water Supply and Geoscience

Prepared by:

New Jersey Department of Environmental Protection

Division of Water Supply and Geoscience

Mail Code 401-04Q

401 E. State Street, P.O. Box 420

Trenton, NJ 08625-0420

(609) 292-5550

watersupply@dep.nj.gov

Table of Contents

Common Acronyms Used in this Report	7
1 INTRODUCTION	8
2 OVERVIEW	8
2.1 DRINKING WATER PROGRAM	8
2.2 NEW JERSEY PUBLIC WATER SYSTEM PROFILE	11
2.3 VIOLATIONS.....	13
2.3.1 MAXIMUM CONTAMINANT LEVELS (MCL).....	14
2.3.2 ACTION LEVEL EXCEEDANCES (ALE)	15
2.3.3 MAXIMUM RESIDUAL DISINFECTANT LEVELS (MRDL)	15
2.3.4 TREATMENT TECHNIQUES.....	15
2.3.5 MONITORING AND REPORTING (M&R).....	15
2.3.6 OTHER REPORTING VIOLATIONS – NOTIFICATION REQUIREMENTS	15
2.3.7 VARIANCES AND EXEMPTIONS.....	16
2.4 ADDITIONAL REQUIREMENTS IN NEW JERSEY.....	16
2.4.1 MONITORING AND REPORTING (M&R).....	16
2.4.2 COMPLIANCE IN 1-YEAR (TT).....	17
2.4.3 LEAD SERVICE LINE REPLACEMENT & INVENTORY.....	17
2.5 CHILD CARE CENTERS	17
2.6 DATA SOURCES FOR THIS REPORT	17
3 SUMMARY OF VIOLATION DATA.....	18
3.1 REVISED TOTAL COLIFORM RULE	20
3.1.1 REVISED TOTAL COLIFORM RULE: MAXIMUM CONTAMINANT LEVEL VIOLATIONS.....	21
3.1.2 REVISED TOTAL COLIFORM RULE: TREATMENT TECHNIQUE VIOLATIONS.....	22
3.1.3 REVISED TOTAL COLIFORM RULE: MONITORING & REPORTING VIOLATIONS	22
3.1.4 REVISED TOTAL COLIFORM RULE: SAMPLE SITING PLAN VIOLATIONS.....	23
3.1.5 REVISED TOTAL COLIFORM RULE: SEASONAL WATER SYSTEM-SPECIFIC VIOLATIONS	23
3.2 GROUND WATER RULE.....	24
3.2.1 GROUND WATER RULE: TREATMENT TECHNIQUE VIOLATIONS.....	26
3.2.2 GROUND WATER RULE: MONITORING & REPORTING VIOLATIONS	26
3.3 DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: TOTAL TRIHALOMETHANES, TOTAL HALOACETIC ACIDS AND DISINFECTANT BY-PRODUCT PRECURSORS	27
3.3.1 DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: MAXIMUM CONTAMINANT LEVEL & MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS	28

3.3.2	DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: TREATMENT TECHNIQUE VIOLATIONS	28
3.3.3	DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: MONITORING & REPORTING VIOLATIONS.....	29
3.4	SURFACE WATER TREATMENT RULES.....	30
3.4.1	SURFACE WATER TREATMENT RULE: TREATMENT TECHNIQUE VIOLATIONS.....	32
3.4.2	SURFACE WATER TREATMENT RULE: MONITORING & REPORTING VIOLATIONS.....	32
3.4.3	LONG-TERM 2 ENHANCED SURFACE WATER TREATMENT RULE VIOLATIONS.....	32
3.5	INORGANIC COMPOUNDS RULE.....	33
3.5.1	INORGANIC COMPOUNDS: MAXIMUM CONTAMINANT LEVEL VIOLATIONS.....	35
3.5.2	INORGANIC COMPOUNDS: MONITORING & REPORTING VIOLATIONS.....	35
3.5.3	INORGANIC COMPOUNDS: TREATMENT TECHNIQUE VIOLATIONS.....	36
3.6	VOLATILE ORGANIC COMPOUNDS RULE.....	37
3.6.1	VOLATILE ORGANIC COMPOUNDS: MAXIMUM CONTAMINANT LEVEL VIOLATIONS.....	38
3.6.2	VOLATILE ORGANIC COMPOUNDS: MONITORING & REPORTING VIOLATIONS.....	38
3.6.3	VOLATILE ORGANIC COMPOUNDS: TREATMENT TECHNIQUE VIOLATIONS.....	39
3.7	RADIOLOGICAL RULE.....	39
3.7.1	RADIOLOGICAL RULE ANALYTICAL TECHNIQUE.....	40
3.7.2	RADIOLOGICAL RULE: MAXIMUM CONTAMINANT LEVEL VIOLATIONS.....	40
3.7.3	RADIOLOGICAL RULE: MONITORING & REPORTING VIOLATIONS.....	40
3.7.4	RADIOLOGICAL RULE: TREATMENT TECHNIQUE VIOLATIONS.....	41
3.8	SYNTHETIC ORGANIC COMPOUNDS RULE.....	41
3.8.1	SYNTHETIC ORGANIC COMPOUNDS RULE: MAXIMUM CONTAMINANT LEVEL VIOLATIONS.....	43
3.8.2	SYNTHETIC ORGANIC COMPOUNDS RULE: MONITORING & REPORTING VIOLATIONS.....	43
3.8.3	SYNTHETIC ORGANIC COMPOUNDS RULE: TREATMENT TECHNIQUE VIOLATIONS.....	43
3.9	PER- AND POLYFLUOROALKYL SUBSTANCES.....	44
3.9.1	PER- AND POLYFLUOROALKYL SUBSTANCES: MAXIMUM CONTAMINANT LEVEL VIOLATIONS	45
3.9.2	PER- AND POLYFLUOROALKYL SUBSTANCES: MONITORING & REPORTING VIOLATIONS..	45
3.9.3	PER- AND POLYFLUOROALKYL SUBSTANCES: TREATMENT TECHNIQUE VIOLATIONS.....	45
3.10	LEAD AND COPPER RULE.....	45
3.10.1	LEAD AND COPPER RULE: ACTION LEVEL EXCEEDANCES.....	47
3.10.2	LEAD AND COPPER RULE: TREATMENT TECHNIQUE VIOLATIONS.....	47
3.10.3	LEAD AND COPPER RULE: MONITORING & REPORTING VIOLATIONS.....	48

3.10.4	LEAD AND COPPER RULE: CHILD CARE SYSTEMS	48
3.11	PUBLIC NOTIFICATION.....	48
3.12	CONSUMER NOTIFICATION VIOLATIONS	49
3.13	ADDITIONAL REQUIREMENTS IN NEW JERSEY.....	49
3.13.1	COMPLIANCE IN 1-YEAR (TT).....	49
3.13.2	REMEDIAL MEASURES REPORTING REQUIREMENTS	50
3.13.3	LEAD SERVICE LINE INVENTORY REPORTING REQUIREMENTS	50
3.13.4	NOTIFICATION OF TIER 1 WITHIN 1 HOUR REPORTING REQUIREMENTS.....	50
Appendix A: List of All Safe Drinking Water Act Violation Types with Federal Reporting Codes		51
Appendix B: Safe Drinking Water Act Violations Incurred by Rule and Category.....		62
Appendix C: Community Water System 2023 Action Level Exceedance, Maximum Contaminant Level Exceedance, and Treatment Technique Violations.....		71
Appendix D: Non-Community, and Non-public Water System 2023 Action Level Exceedance, Maximum Contaminant Level Exceedance, and Treatment Technique violations.....		106

Tables

Table 1:	New Jersey Community Water Systems Grouped by Residential Population Served in 2023.....	12
Table 2:	New Jersey Specific Maximum Contaminant Level.....	14
Table 3:	Summary of Safe Drinking Act Violations	18
Table 4:	Revised Total Coliform Rule Violations by System Type	21
Table 5:	Revised Total Coliform Rule Violations at Seasonal Systems.....	24
Table 6:	Ground Water Rule Violations by System Type	25
Table 7:	Disinfectant and Disinfection By-Product Rule Violations by System Type	28
Table 8:	Surface Water Treatment Rule Violations by System Type	31
Table 9:	Maximum Contaminant Levels for Inorganic Compounds.....	33
Table 10:	Nitrate/Nitrite Violations by System Type	34
Table 11:	Inorganic Compound Rule Violations by System Type	35
Table 12:	Maximum Contaminant Levels for Volatile Organic Compounds	37
Table 13:	Volatile Organic Compound Rule Violations by System Type	38
Table 14:	Radiological Rule Violations by System Type	39
Table 15:	Maximum Contaminant Levels for Synthetic Organic Compounds	42
Table 16:	Synthetic Organic Compound Rule Violations by System Type	43
Table 17:	Maximum Contaminant Levels for Perfluorononanoic acids.....	44
Table 18:	Perfluorononanoic acid Rule violations by system type	43
Table 19:	Lead and Copper Rule Violations by System Type	47

Figures

Figure 1: Distribution of 3,497 Public Water Systems in New Jersey During 2023.....	11
Figure 2: Active New Jersey Public Water Systems by Calendar Year (2020 through 2023)	12
Figure 3A: Comparison of 2021, 2022, and 2023 Number of Maximum Contaminant Level (MCL), Monitoring and Reporting (M&R), and Total Violations Incurred by Public Water Systems for PFAS.....	19
Figure 3B: Comparison of 2021, 2022, and 2023 Number of Monitoring and Reporting (M&R) Violations Incurred by Public Water Systems for Water Quality Parameters (WQP), and Number of Public Water Systems with Designated Optimal WQPs	20
Figure 4: Percentage of Public Water Systems with and without Revised Total Coliform Rule Violations during 2023	22
Figure 5: Percentage of types of violations incurred under the Revised Total Coliform Rule in 2023	22
Figure 6: Percentage of Seasonal Public Water Systems with and without Revised Total Coliform Rule seasonal specific Violations during 2023	24
Figure 7: Percentage of types of seasonal specific violations incurred under the Revised Total Coliform Rule in 2023.....	24
Figure 8: Percentage of Public Water Systems with and without Ground Water Rule Violations during 2023.....	25
Figure 9: Percentage of types of violations incurred under the Ground Water Rule in 2023	25
Figure 10: Percentage of Public Water Systems with and without Disinfectants and Disinfection Byproduct Rule Violations during 2023	29
Figure 11: Percentage of types of violations incurred under the Disinfectants and Disinfection Byproduct Rule in 2023.....	29
Figure 12: Percentage of Public Water Systems with and without Surface Water Treatment Rule Violations during 2023	31
Figure 13: Percentage of types of violations incurred under the Surface Water Treatment Rule in 2023	31
Figure 14: Percentage of Public Water Systems with and without nitrate violations during 2023.....	34
Figure 15: Percentage of types of violations incurred for nitrate in 2023.....	34
Figure 16: Percentage of Public Water Systems (PWS) with and without Inorganic Compound (excluding Nitrate) Violations during 2023.....	35
Figure 17: Percentage of types of violations incurred for Inorganic Compound (excluding Nitrate) in 2023	35
Figure 18: Percentage of Public Water Systems with and without Volatile Organic Compound Rule violations during 2023.....	38
Figure 19: Percentage of types of violations incurred for Volatile Organic Compound Rule in 2023	38
Figure 20: Percentage of Public Water Systems with and without Radiological Rule violations during 2023	40
Figure 21: Percentage of types of violations incurred for Radiological Rule during 2023.....	40
Figure 22: Percentage of Public Water Systems with and without Synthetic Organic Compound Rule violations during 2023.....	43
Figure 23: Percentage of types of violations incurred for Synthetic Organic Compound Rule in 2023	43
Figure 24: Percentage of Public Water Systems with and without Perfluorononanoic Acid violations during 2023	45
Figure 25: Percentage of types of violations incurred for Perfluorononanoic Acid in 2023.....	45
Figure 26: Percentage of Public Water Systems with and without Lead and Copper Rule violations during 2023.....	47
Figure 27: Percentage of types of violations incurred under the Lead and Copper Rule during 2023.....	47

Common Acronyms Used in this Report

Acronym	Definition
1,2,3-TCP	1,2,3-Trichloropropane
AL	Action Level
ALE	Action Level Exceedance
EDB	Ethylene dibromide
DBCP	Dibromochloropropane
HAA5	Haloacetic Acids
M&R	Monitoring and Reporting
MCL	Maximum Contaminant Level
MRDL	Maximum Residual Disinfectant Levels
NJDEP	New Jersey Department of Environmental Protection
NTU	Nephelometric Turbidity Units
PFAS	Per- and polyfluoroalkyl substances
PFNA	Perfluorononanoic Acid
PFOA	Perfluorooctanoic Acid
PFOS	Perfluorooctanesulfonic Acid
SDWA	Safe Drinking Water Act
SDWIS/State	Safe Drinking Water Information System
TT	Treatment Technique
TTHM	Total Trihalomethanes
USEPA	United States Environmental Protection Agency

1 INTRODUCTION

The federal Safe Drinking Water Act (SDWA) in Section 1414(c)(3)(A) requires states to prepare an annual report on violations of the national primary drinking water regulations incurred by public water systems. The statutory language requiring an annual report by states specifies that each state shall prepare, make readily available to the public, and submit to the United States Environmental Protection Agency (USEPA) an annual report on violations of national primary drinking water regulations by public water systems in the state, including violations with respect to 1) maximum contaminant levels, 2) treatment requirements, 3) variances and exemptions, and 4) monitoring requirements. Additionally, the state shall publish and distribute summaries of the report and indicate where the full report is available for review.

This report, prepared by the New Jersey Department of Environmental Protection (NJDEP), Division of Water Supply & Geoscience (Division), covers the period of January 1, 2023 to December 31, 2023, and provides details for five (5) categories of violations: exceeding maximum contaminant levels (MCL), exceeding maximum residual disinfectant levels (MRDL), failure to comply with treatment or operational requirements, known as treatment techniques (TT), significant failure to meet monitoring and reporting requirements (M&R), and significant failure to provide public notifications, Lead Consumer Notices and/or Consumer Confidence Reports. Violations of the New Jersey SDWA are also included in this report. Follow-up compliance-related activities associated with these violations through May 8, 2024, are indicated.

2 OVERVIEW

2.1 DRINKING WATER PROGRAM

Under the federal SDWA of 1974 and subsequent 1986 and 1996 amendments, the USEPA set national limits on contaminant levels in drinking water, known as MCLs, to ensure drinking water is safe for human consumption. Action levels (AL) for lead and copper and MRDLs for disinfectant residuals were also established, in lieu of MCLs, to control unacceptable levels, and TT were established to ensure that follow-up activities were conducted to address identified issues. The USEPA also regulates how often public water systems monitor their drinking water for contaminants and how often they report the monitoring results to the state or the USEPA. Generally, the larger the population served by a public water system, the more frequently monitoring and reporting must occur. Finally, the USEPA requires public notification of violations, which must include a clear and understandable explanation of the nature of the violation, the potential adverse health effects, the steps a public water system is taking to correct the violation and, if applicable, the possibility of using an alternative water supply until the violation is resolved.

The federal SDWA allows states and territories to seek USEPA approval to regulate public water systems under an authority called primacy. To receive primacy, a state must meet certain requirements, including adoption of drinking water regulations equal to or stricter than federal regulations and demonstration that these requirements can be enforced. New Jersey has received primacy from USEPA for all drinking water regulations except for the more recently finalized Lead and Copper Rule Revisions (LCRR), National Primary Drinking Water Regulation (NPDWR) for PFAS and Consumer Confidence Report (CCR) Rule Revisions. New Jersey is working to obtain primacy for these recent federal regulations.

Between 2018 and 2020 New Jersey promulgated changes to the New Jersey SDWA rules at N.J.A.C. 7:10-5.2. These rules established four (4) new State-specific MCLs: 0.013 micrograms per liter ($\mu\text{g/l}$) for perfluorononanoic acid (PFNA) and 0.030 $\mu\text{g/l}$ for 1,2,3-trichloropropane (1,2,3-TCP) in 2018, and 0.014 micrograms per liter ($\mu\text{g/l}$) for perfluorooctanoic acid (PFOA) and 0.013 $\mu\text{g/l}$ for perfluorooctanesulfonic acid (PFOS) in 2020. It is significant to note that the regulation of these compounds has resulted in a large increase in the number of violations issued to public water systems. As mentioned above, USEPA finalized its NPDWR for PFAS in April 2024, establishing MCLs for PFOA and PFOS set at 0.004 $\mu\text{g/L}$, as well as for PFNA, PFHxS, and HFPO-DA (commonly referred to as GenX Chemicals) set at 0.01 $\mu\text{g/L}$. In addition to the MCLs, EPA finalized regulations for PFAS mixtures containing two or more of PFNA, PFHxS, HFPO-DA, and PFBS using a Hazard Index MCL set to 1 (unitless). It is anticipated that these new NPDWRs will result in additional PFAS violations from public water systems.

Since 2014, NJDEP has placed an increased focus on reducing New Jersey residents' exposure to lead and copper through drinking water. Even prior to the events of Flint, Michigan, NJDEP reevaluated its implementation of EPA's Lead and Copper Rule (LCR) and became more stringent within the limits of the rule focusing on establishing water quality parameters for all large public water systems and those with corrosion control treatment and requiring selected public water systems to submit their lead and copper sampling plans for review and approval. The outcome of these actions determined more stringent lead and copper regulations were warranted for the protection of public health; therefore, New Jersey began developing its own Lead and Copper Rule. Focus Group Sessions were held in 2019 followed by Stakeholder Meetings in 2020 and 2021. On July 22, 2021, New Jersey signed legislation into law for mandatory lead service line (LSL) replacement, effective immediately upon signature. See N.J.S.A. 12A-40 through 47. Public community water systems are required to inventory and replace all known lead service lines at an annual average replacement rate of at least 10 percent and identify all service lines of unknown materials in their service areas by July 22, 2031 (with the possibility of an extension of up to five years, i.e., 2036).


NJDEP is in the final stages of reviewing the state's Lead and Copper Rule proposal ensuring it does not conflict with EPA's Lead and Copper Rule Revisions (LCRR), incorporates state statute requirements, and incorporates the most current scientific available data. The NJDEP anticipates the rule will be proposed by the end of 2024.

Until then, New Jersey is receiving and data managing community water system LSL inventories and replacement plans, continuing to establish optimal water quality parameters, conducting thorough corrosion control treatment evaluations, and planning for conducting surveys of noncommunity water systems to determine if a lead service line is present and the preparing for the LCRR requirements that take effect in October 2024.

Within the NJDEP, the Division has responsibility under both the federal SDWA and the New Jersey SDWA to assure safe drinking water for citizens and visitors of New Jersey. In addition, the NJDEP has contracts with the County Environmental Health Agencies (CEHA) to assist with the management of these regulations at the county and/or local level. The CEHA, and in some cases the local health departments, have Administrative Authority over certain classes of public water systems (NTNC, TNC) and are the lead for enforcement actions related to violations issued to those systems. This report reflects the initial violations issued to all PWS by the NJDEP.

Although the federal SDWA regulations generally do not specify a timeframe for returning to compliance, the New Jersey SDWA requires public water systems to return to compliance by taking necessary corrective actions to address MCL violations for contaminants with health effects within one (1) year of becoming aware of the violation. The Division, with support from NJDEP’s Division of Water Enforcement and the County Environmental Health Agencies, continues to make progress in identifying and addressing violations of both the federal and state SDWAs.

In 2023, NJDEP updated its Capacity Development Strategy to better assist public water systems in need of Technical, Managerial, and Financial Capacity assistance. The new strategy focuses on providing direct technical assistance to public water systems with lead, PFAS and other SDWA compliance issues, especially those serving disadvantaged communities. NJDEP launched its New Jersey-Technical Assistance Program (NJ-TAP), in coordination with the New Jersey Water Bank, to provide free assistance to public water systems to identify lead service lines, develop asset management and capital improvement plans, identify sources of state and federal funding, and engage the community to promote investment in critical public water system infrastructure improvement projects.

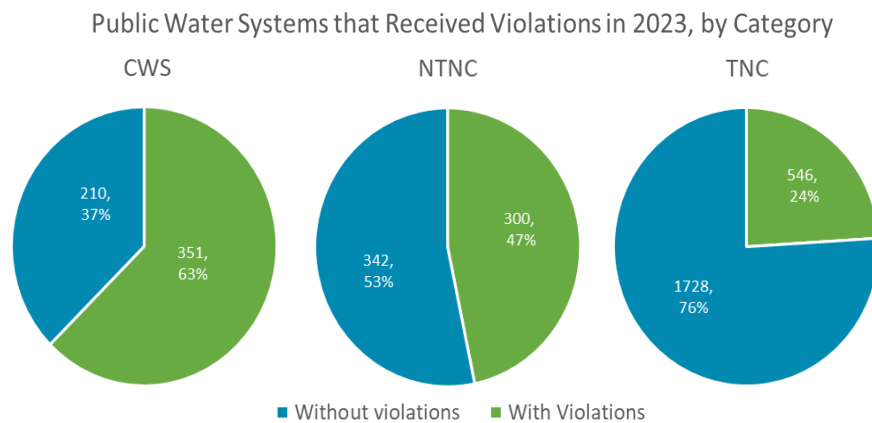

2.2 NEW JERSEY PUBLIC WATER SYSTEM PROFILE

The federal regulations define a public water system as a system that provides water for human consumption through pipes or other constructed conveyances if the system has at least 15 service connections or regularly serves at least 25 individuals for at least 60 days out of the year.

Public water systems are divided into community water systems such as privately owned or municipal water systems, i.e., “city water” which serves residential populations, and noncommunity water systems, generally businesses supplied by their own wells. Noncommunity water systems are further divided into nontransient noncommunity water systems, such as schools or factories with their own wells, and transient noncommunity water systems, such as rest stops or parks with their own wells. When the term “public water system” or “public water systems” is used in this report, it refers to all water system types unless otherwise specified.

As of December 31, 2023, New Jersey identified 3,477 active public water systems in its inventory, including 561 community water systems, 642 nontransient noncommunity water systems, and 2,274 transient noncommunity water systems. Figure 1 illustrates the percent of public water systems by type.

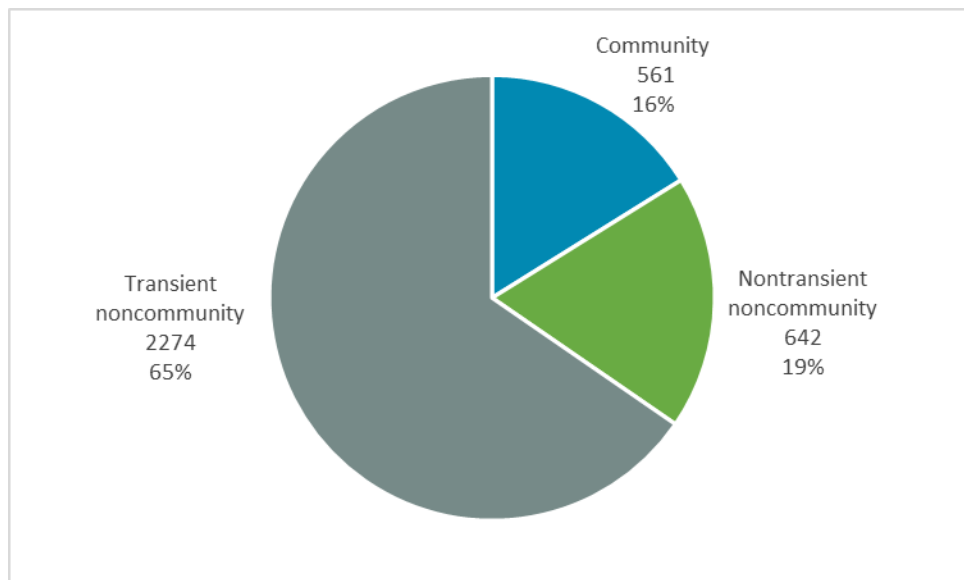


Figure 1: Distribution of 3,477 Public Water Systems in New Jersey During 2023.

The number of public water systems changes from year-to-year due to public water system mergers, opening and closing of businesses, connections of nontransient noncommunity or transient noncommunity water systems to community water systems, or changes in population that result in the reclassification or deactivation of a public water system. Figure 2 below depicts changes in the number of public water systems for the past four years.

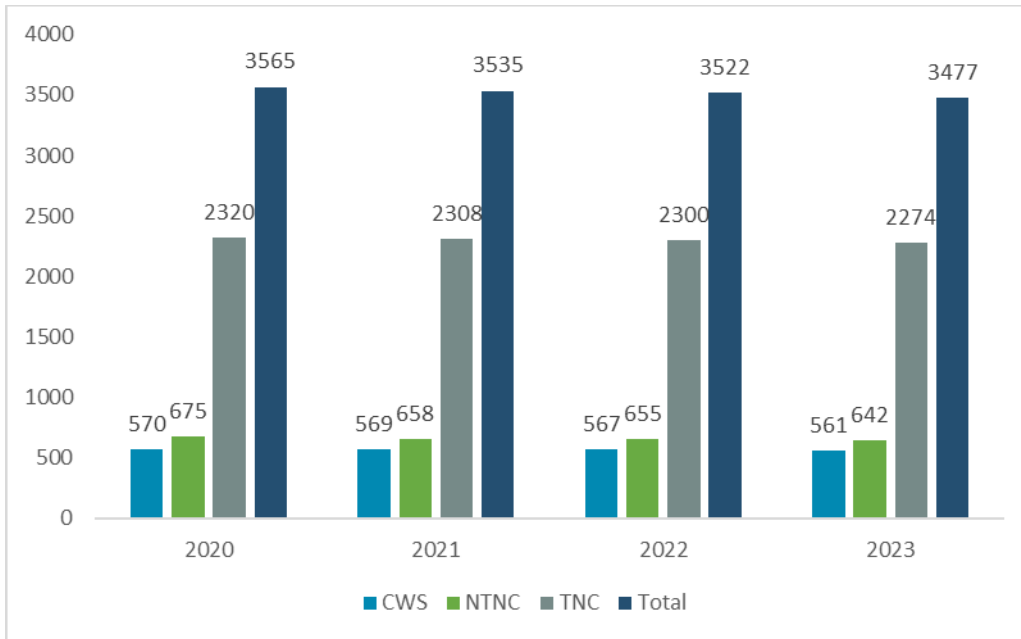


Figure 2: Active New Jersey Public Water Systems by Calendar Year (2020 through 2023)

Community water systems are further classified as small, medium, or large based on the residential populations that they serve. The size classification of a public water system will determine the frequency and the amount of sampling that is required. Community water systems supply water to 87% of New Jersey residents. Table 1 provides a summary of the population served by various sized community water systems. There are four community water systems included in Table 1 that are 100% wholesalers and do not directly serve a residential population.

Table 1: New Jersey Community Water Systems Grouped by Residential Population in 2023.

Population Categories	Population Ranges	Number of Systems	Total Estimated Population Served
Large Systems	> 50,000	25	4,657,061
Medium Systems	10,001 – 50,000	117	2,699,359
	3,301 – 10,000	81	509,153
Small Systems	1,001 - 3,300	83	160,299
	501 – 1,000	45	33,254
	101-500	117	29,462
	<101	89	6,255
100% Wholesalers	N/A	4	N/A
Total:		561	8,094,843

2.3 VIOLATIONS

The federal SDWA is sub-divided into various rules. These include the Revised Total Coliform Rule, Ground Water Rule, Disinfectant and Disinfection By-Product Rules (Stage 1 and Stage 2), Surface Water Treatment Rules, Inorganic Compound Rule, Volatile Organic Compound Rule, Radiological Rule, Synthetic Organic Compound Rule, Lead and Copper Rule, and the Public Notification Rule. Each of these rules has specific violation types for failure to meet any of their individual requirements. Further details concerning these rules are provided in Section 3.

The violations incurred by public water systems for any of the above rules fall into several distinct categories, the major ones being:

- 1) Maximum Contaminant Level (MCL) exceedances: where the highest allowable contaminant concentrations in drinking water are exceeded;
- 2) Maximum Residual Disinfectant Level (MRDL) exceedances: where the maximum residual disinfectant levels, which specify the highest concentrations of disinfectants allowed in drinking water are exceeded;
- 3) TT violations: where a public water system fails to comply with treatment or operational requirements intended to reduce the levels of contaminants;
- 4) Monitoring and Reporting (M&R) violations: where a public water system fails to conduct scheduled monitoring or fails to submit monitoring results on time, as required by the federal and state SDWAs; and
- 5) Reporting violations: where a public water system fails to meet notification requirements regarding Public Notification, Consumer Confidence Report, and Lead Consumer Notices.

There are also state-specific MCL, TT, M&R, and reporting violation types for when a public water system does not comply with state-specific SDWA requirements.



2.3.1 MAXIMUM CONTAMINANT LEVELS (MCL)

The USEPA set MCLs at the national level. A MCL is the allowable limit of a contaminant in drinking water to ensure it is safe for human consumption. MCLs ensure that drinking water does not pose either a short-term or long-term health risk. New Jersey has adopted all the federal MCLs. In addition to the national standards, the 1984 amendments to the New Jersey SDWA establish New Jersey’s Drinking Water Quality Institute, along with a process for setting drinking water standards. The Drinking Water Quality Institute is responsible for developing MCLs or standards for hazardous contaminants in drinking water and for recommending those standards as well as recommendations for the implementation of the drinking water quality program to the Commissioner of the NJDEP. Additionally, the Drinking Water Quality Institute has the authority to select additional contaminants to regulate, if needed. Both the federal SDWA and the New Jersey SDWA require that any standards adopted by the NJDEP be equal to or more stringent than federal standards.

New Jersey has fourteen (14) contaminants that have more stringent MCLs than the federal MCLs: twelve (12) volatile organic compounds, one (1) synthetic organic compound, and one (1) inorganic chemical. There are also nine (9) additional compounds that are regulated as primary contaminants by New Jersey that do not have a federal MCL: five (5) volatile organic compounds, one (1) synthetic organic compound, and three (3) per and- polyfluoroalkyl substances. See Table 2 for a listing of these specific contaminants and their MCLs.

New Jersey has also included the requirement for gross alpha to be analyzed using the 48-Hour Rapid Gross Alpha Test methodology as per the Regulations Governing the Certification of Laboratories and Environmental Measurements at N.J.A.C. 7:18. The New Jersey required method includes the alpha particle activity of radium-224, which is not captured using the standard USEPA method.

Table 2: New Jersey Specific Maximum Contaminant Levels (MCLs) Compared to Federal MCLs Where Applicable

Contaminant	MCL (µg/l)	
	NJ	USEPA
Arsenic	5	10
Benzene	1	5
Carbon Tetrachloride	2	5
Chlordane	0.5	2
Chlorobenzene	50	100
1,2-Dichloroethane	2	5
1,1-Dichloroethylene	2	7
Gross alpha (using a rapid analysis method)*	15	15
Methylene Chloride	3	5
Tetrachloroethylene	1	5
1,2,4-Trichlorobenzene	9	70
1,1,1-Trichloroethane	30	200
1,1,2-Trichloroethane	3	5
Trichloroethylene	1	5
Xylenes	1,000	10,000
1,3-Dichlorobenzene	600	N/A
1,1-Dichloroethane	50	N/A
Methyl tertiary Butyl Ether	70	N/A
Naphthalene	300	N/A
1,1,2,2-Tetrachloroethane	1	N/A
1,2,3-Trichloropropane	0.030	N/A
Perfluorononanoic Acid**	0.013	N/A
Perfluorooctanoic acid**	0.014	N/A
Perfluorooctanesulfonic acid ^b **	0.013	N/A

* Captures alpha emitting radionuclides with short half-lives, such as radium-224; units are pCi/L

**As of April 10, 2024, USEPA has established new MCLs for these contaminants

2.3.2 ACTION LEVEL EXCEEDANCES (ALE)

In lieu of MCLs, the USEPA has established action levels (AL) for lead and copper. An AL is defined as the concentration of lead or copper in water above which specific actions are required to be completed. Although a public water system is not in violation of the federal regulations if they have an action level exceedance (ALE), they must begin to take steps to remediate the high levels of lead and/or copper. Public education, water quality parameter monitoring, corrosion control treatment evaluation and the installation of treatment all must follow the exceedance of an AL and the public water system will receive a violation if they fail to take any of the required steps.

2.3.3 MAXIMUM RESIDUAL DISINFECTANT LEVELS (MRDL)

The USEPA set national limits on residual disinfectant levels in drinking water to reduce the risk of exposure to disinfection byproducts formed when a public water system adds chemical disinfection. These limits are known as MRDLs, and they ensure that the chemical disinfectant added to the water will not pose an unintended health risk.

2.3.4 TREATMENT TECHNIQUES

The USEPA established TT instead of MCLs to control unacceptable levels of specified contaminants. A TT is a required process intended to reduce the level of a contaminant in drinking water. TT have been established for viruses, bacteria, disinfection byproduct precursors (total organic carbon and alkalinity), turbidity, and lead and copper.

2.3.5 MONITORING AND REPORTING (M&R)

Public water systems are required to monitor the levels of contaminants that may be present in their water and are required to submit the results within the timeframes specified by the regulations. Major categories of contaminants monitored in public community drinking water supplies are microbiological, inorganic chemicals including lead and copper, volatile organic chemicals, synthetic organic chemicals including pesticides, radionuclides, turbidity, disinfection residuals, disinfection byproducts and disinfection precursors. If a public water system fails to perform the required monitoring, they incur a monitoring violation. If a public water system performs the required monitoring but fails to report the results within the specified timeframe, they incur a reporting violation. The federal SDWA does not differentiate between monitoring and reporting violations, except for the Revised Total Coliform Rule, which specifically splits a monitoring violation from a reporting violation. This allows USEPA to better track and address true monitoring violations (not conducting the required monitoring) from late or non-submittal violations, which do not have as detrimental an effect on public health. M&R violations are further defined as Major, when none of the required monitoring is performed, and Minor, when some, but not all, of the required monitoring is performed.

2.3.6 OTHER REPORTING VIOLATIONS – NOTIFICATION REQUIREMENTS

The federal SDWA has provisions to ensure that consumers will know if there is a problem with their drinking water and requires a public notification be sent to all persons served if there is risk to public health due to either not meeting a drinking water standard, not completing a

required TT activity or failing to conduct required monitoring. There are three (3) tiers of public notification, based on the severity of the violation – Tier 1 public notification is required for MCL violations of contaminants with acute health effects as a result of short-term exposure, such as bacteria; Tier 2 public notification is required for MCL violations of contaminants with chronic effects or the failure to complete a required TT activity, and a Tier 3 public notification is required for all monitoring and reporting violations.

The federal SDWA requires all community water systems to prepare and distribute a Consumer Confidence Report to all bill paying customers served by the public water system. The Consumer Confidence Report must contain information on the quality of the water delivered by the public water systems and characterize the risks (if any) from exposure to contaminants detected in the drinking water in an accurate and understandable manner. Consumer Confidence Reports must be sent to bill paying customers by July 1st each year, with a certification sent to the state that the Consumer Confidence Report was properly distributed. All public water systems that fail to send out their Consumer Confidence Report or submit their certification on time will incur violations. In addition, New Jersey performs a review on a subset of these reports each year and issues violations if the content is deficient.

The federal SDWA also requires all community and nontransient noncommunity water systems to prepare and distribute a Lead Consumer Notice to all customers occupying homes or buildings that were sampled as part of the public water system's lead and copper sampling event within 30 days of receiving the sample results. A copy of the Lead Consumer Notice, along with a certification that the notices were properly prepared and issued, must be sent to the state within 90 days of receiving the sample results. Public water systems incur a violation if they fail to distribute the Lead Consumer Notice.

2.3.7 VARIANCES AND EXEMPTIONS

Federal primary drinking water regulations allow for variances and exemptions to specific requirements to be granted in certain cases, but only if public health is protected. Examples of such cases include a public water system that cannot meet the MCL immediately based on raw water features or a small public water system that cannot afford to meet non-microbial MCLs. The NJDEP has never issued a variance or an exemption, and the regulations on variances and exemptions (Subchapter 6) of the New Jersey SDWA regulations were repealed effective November 4, 2004.

2.4 ADDITIONAL REQUIREMENTS IN NEW JERSEY

2.4.1 MONITORING AND REPORTING (M&R)

Monitoring is required for New Jersey-specific MCLs for three (3) Per- and polyfluoroalkyl substances (PFAS) (Perfluorononanoic acid (PFNA), Perfluorooctanoic acid (PFOA), Perfluorooctanesulfonic acid (PFOS) and one (1) Synthetic Organic Contaminant 1,2,3-trichloropropane (1,2,3-TCP). Additionally, radionuclide monitoring is required at all nontransient noncommunity water systems.

2.4.2 COMPLIANCE IN 1-YEAR (TT)

The state SDWA requires any public water system that exceeds a federal or state MCL to take any action necessary to bring the water into compliance with the applicable MCL within one (1) year after receipt of the sample results that demonstrated an exceedance of the MCL. Public water systems incur a state-type TT violation if they fail to return to compliance with the MCL within the one (1) year timeframe.

2.4.3 LEAD SERVICE LINE REPLACEMENT & INVENTORY

There are several deadlines required to be met by all public community water systems prior to, and to support, the 10-year lead service line replacement timeframe. Public water systems were required to submit an initial inventory, consisting of counts of lead service lines, service lines of unknown composition, and lead service lines to be replaced annually. Public community water systems are required to submit to the NJDEP an annual updated inventory, replacement report, and plan every July henceforth.

2.5 CHILD CARE CENTERS

Under federal regulation, transient noncommunity water systems are only required to sample for coliform bacteria and nitrate. State regulations, however, require all child care centers that have their own source of water, whether classified as a nontransient noncommunity water system, a transient noncommunity water system, or a non-public water system, to sample *and meet* all nontransient noncommunity water system monitoring requirements and MCLs at the time of their license renewal. Any transient noncommunity water system or non-public system that exceeds a MCL or AL is required to take steps, as if it is a nontransient noncommunity water system, to return to compliance.

2.6 DATA SOURCES FOR THIS REPORT

This annual report includes drinking water violation data that covers the period of January 1 through December 31, 2023, with updated compliance activities completed as of May 8, 2024. The data for this report was compiled using the New Jersey Safe Drinking Water Information System (SDWIS/State) database, which houses information about each public water system along with their sample results. SDWIS/State then compares the sample results against federal and state SDWA requirements and generates violations when applicable.

The USEPA has developed a tool for analyzing drinking water data called Enforcement and Compliance History Online, at <https://echo.epa.gov/?redirect=echo>. This tool can be used to generate a compliance summary report for each state which provides the total annual number of violations as well as the names of the public water systems with violations for each of six (6) categories: MCLs, MRDLs, TT, variances and exemptions, significant M&R violations and significant consumer notification violations. The data used by USEPA to generate the summary report are provided to the USEPA on a quarterly basis from SDWIS/State and are stored in USEPA's federal database.

A comparison of compliance reports generated using the Enforcement and Compliance History Online tool and those generated using SDWIS/State may differ for two main reasons: 1) the Enforcement and Compliance History Online tool uses a snapshot of a state’s data for generating reports that is always at least one quarter behind the current calendar quarter. States report violation data to the USEPA on a quarterly basis and the USEPA then reviews the quarterly violation data before posting the data on their website to be used for Enforcement and Compliance History Online reports. Because New Jersey addresses data errors and updates violation status on a daily basis and is able to generate up-to-date reports, New Jersey’s reports generally lag by only one day; and 2) MCL, TT, M&R and Reporting violations that are specific to New Jersey’s requirements are included in this Annual Report and these violations are not required to be reported to USEPA; and therefore, will not be reported in the Enforcement and Compliance History Online tool.

To see the most comprehensive and up-to-date information available, use the Division’s Drinking Water Watch tool, accessible online at www.nj.gov/dep/watersupply/waterwatch.

3 SUMMARY OF VIOLATION DATA

A review of each SDWA rule and summary of the 2023 violation data identified under each rule is presented below in Table 3. In addition, a list of all violation types, along with their federal reporting codes are included in Appendix A; a summary listing of New Jersey public water system violations by rule and contaminant can be found in Appendix B; a listing of individual MCLs, ALE, MRDL and TT violations for community water systems can be found in Appendix C; and a listing of individual MCL, ALE, MRDL and TT violations for nontransient noncommunity water systems can be found in Appendix D.

Table 3: Summary of all Safe Drinking Water Act Violations (Maximum Contaminant Level (MCL), Action Level Exceedance (ALE), Maximum Residual Disinfection Level (MRDL) and Treatment Technique (TT)) by System Type for 2023.

TYPE OF SYSTEM	EXCEEDANCES*			TT VIOLATIONS	MONITORING & REPORTING			TOTAL VIOLATIONS
	MCL	ALE	MRDL		Monitoring	Reporting	Public Notification	
COMMUNITY 561 SYSTEMS	256 (35)	10 (10)	0	80 (56)	972 (200)	612 (245)	42 (29)	1972 (351)
NONTRANSIENT NONCOMMUNITY 642 SYSTEMS	69 (25)	29 (26)	0	83 (61)	1063 (165)	227 (169)	34 (25)	1505 (300)
TRANSIENT NONCOMMUNITY 2,274 SYSTEMS	29 (21)	1 (1)	0	184 (150)	738 (375)	627 (330)	31 (24)	1610 (546)
GRAND TOTAL VIOLATIONS	354	40	0	347	2773	1466	107	5087

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

From 2021 to 2023, the number of total PFAS violations has notably decreased. However, there was an increase in total violations from 2021 to 2022 due to an uptick in MCL violations, as shown below in Figure 3A. The drop in total violations in 2023 is primarily due to the installation of permanent and temporary remedial measures.

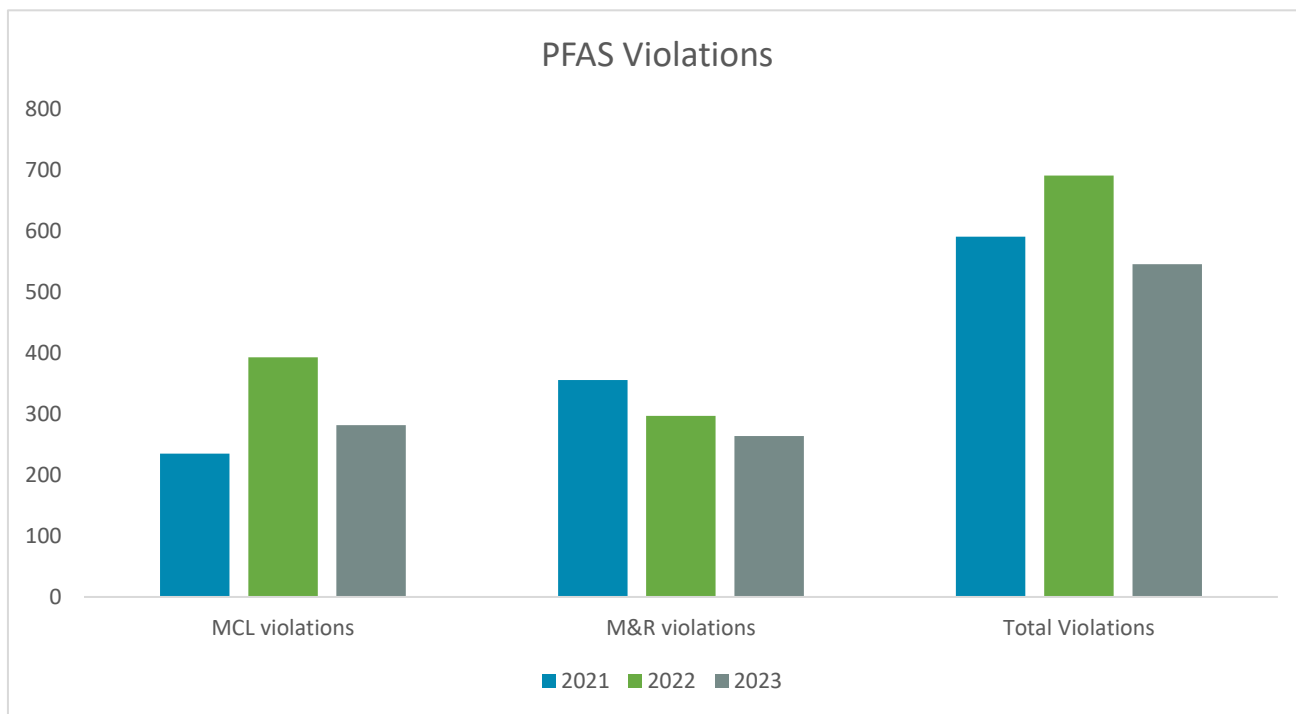


Figure 3A: Comparison of 2021, 2022, and 2023 Number of Maximum Contaminant Level (MCL), Monitoring and Reporting (M&R), and Total Violations Incurred by Public Water Systems for PFAS.

Public water systems in New Jersey that have corrosion control treatment (CCT) installed are required to continuously monitor for water quality parameters (WQPs), regardless of the occurrence of an action level exceedance. The number of public water systems with designated optimal WQPs, as well as the number of M&R violations incurred for WQPs, have increased from 2021 to 2023. Figure 3B illustrates the comparison of WQP M&R violations incurred from 2021 to 2023, alongside the number of public water systems required to monitor for optimal WQPs.

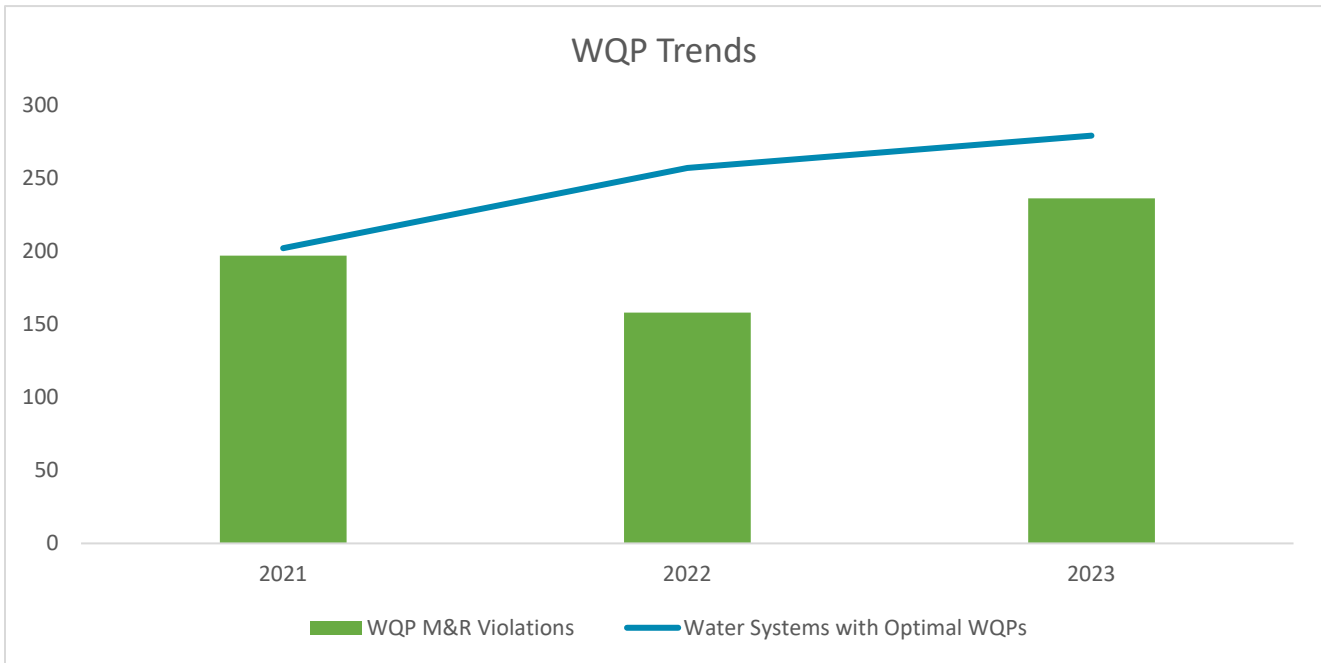


Figure 3B: Comparison of 2021, 2022, and 2023 Number of Monitoring and Reporting (M&R) Violations Incurred by Public Water Systems for Water Quality Parameters (WQP), and Number of Public Water Systems with Designated Optimal WQPs.

3.1 REVISED TOTAL COLIFORM RULE

The Revised Total Coliform Rule, effective in April 2016, is a revision of the 1989 Total Coliform Rule and is the only microbial rule that applies to all 3,477 New Jersey public water systems, including all transient noncommunity water systems. Under the Revised Total Coliform Rule, public water systems are required to monitor for the presence of total coliform and *E. coli* in drinking water at a frequency based on the type of public water system and the number of people served. Community water systems and seasonal noncommunity water systems sample monthly, while non-seasonal noncommunity water systems sample quarterly.

Total coliform bacteria are generally not harmful themselves, but their presence in drinking water indicates a potential pathway for contamination into the distribution system. However, the presence of *E. coli*, a type of coliform bacteria, does indicate a health risk. To address this risk, the Revised Total Coliform Rule adopts a “find and fix” approach which requires the public water system to conduct an assessment based on the frequency and severity of the contamination to identify problems and take subsequent corrective action within a specified timeframe. A basic review, or Level 1 Assessment, is required based on the confirmed presence of total coliform bacteria, while a more comprehensive review, or Level 2 Assessment, is required for a public water system with serious and/or chronic issues i.e., public water system with a confirmed *E. coli* presence or repeated total coliform positive results within a rolling 12-month period.

In 2023, only 15 (0.6%) public water systems had Revised Total Coliform Rule MCL violations and 91 (2.6%) had Revised Total Coliform Rule TT violations; these are the violation types that can have the most serious acute health effects on consumers. Table 4 below lists the details for all violations incurred under the Revised Total Coliform Rule. Figure 4 illustrates the overall percentage of public water systems that incurred Revised Total Coliform Rule violations and Figure 5 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.1.1 through 3.1.3.

Table 4: Revised Total Coliform Rule Violations by Public Water System Type for Maximum Contaminant (MCL) Level Exceedances, Treatment Techniques (TT), Monitoring, and Reporting for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPE*				TOTAL OF VIOLATIONS
	MCL	TT	Monitoring	Reporting	
COMMUNITY	1 (1)	3 (3)	67 (30)	57 (33)	128
NONTRANSIENT NONCOMMUNITY	0 (0)	12 (12)	65 (42)	68 (41)	145
TRANSIENT NONCOMMUNITY	15 (14)	95 (76)	481 (283)	625 (330)	1216
GRAND TOTAL OF VIOLATIONS	16 (15)	110 (91)	613 (355)	750 (404)	1489

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

3.1.1 REVISED TOTAL COLIFORM RULE: MAXIMUM CONTAMINANT LEVEL VIOLATIONS

Under the Revised Total Coliform Rule, a violation is not issued based on the confirmed presence of total coliform. Instead, when the presence of total coliform is confirmed (i.e. at least one (1) repeat sample is positive, or repeat samples are not collected; and therefore, assumed to be positive), the public water system is required to conduct a basic Level 1 Assessment to identify and eliminate the potential pathways for contamination. Public water systems that trigger a second Level 1 Assessment within a rolling 12-month period are also required to conduct the more comprehensive Level 2 Assessment.

If it is determined *E. coli* is present in the public water system, an acute MCL violation is incurred, and a Level 2 Assessment is required. A Do Not Drink Advisory, or Boil Water Advisory must also be issued until the violation has been resolved.

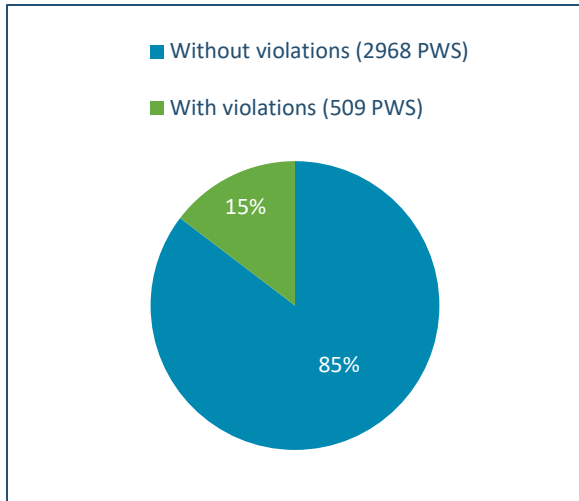


Figure 4: Percentage of Public Water Systems (PWS) with and without Revised Total Coliform Rule Violations during 2023.

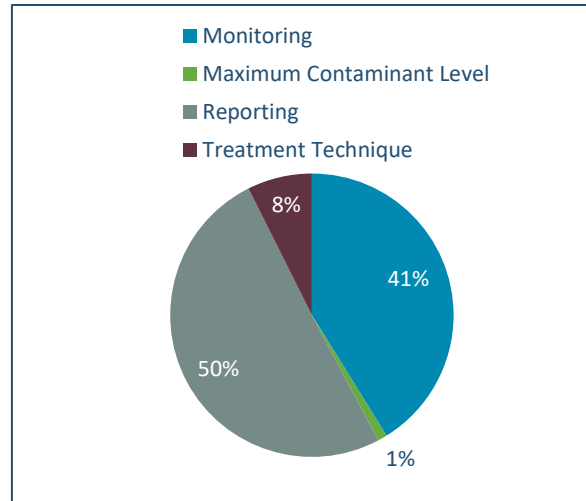


Figure 5: Percentage of types of violations incurred under the Revised Total Coliform Rule in 2023.

In 2023, there were 16 *E. coli* positive MCL violations at 15 public water systems; as of May 8, 2024, 11 of the 16 (69%) public water systems have returned to compliance. Of the remaining five (5) public water systems, four (4) have since returned to compliance after May 8, 2024, and one (1) has been referred to the administrative authority (county). One (1) of the three (3) public water systems is also under the Ground Water Rule and is captured below.

3.1.2 REVISED TOTAL COLIFORM RULE: TREATMENT TECHNIQUE VIOLATIONS

Under the Revised Total Coliform Rule, public water systems that fail to complete the required Level 1 or Level 2 Assessment within 30 days of triggering the need for the assessment are issued TT violations. Public water systems that complete their Level Assessments but fail to complete the corrective actions required to remedy the situation, also receive a TT violation.

In 2023, 106 TT violations were issued for the failure to conduct a required Level 1 or Level 2 Assessment at 88 public water systems and 4 TT violations were issued for the failure to complete required corrective actions at 4 public water systems. As of May 8, 2024, 42 of the 88 (48%) public water systems completed their Level 1 or Level 2 Assessment and returned to compliance and 3 of the 4 (75%) public water systems completed their required corrective actions and returned to compliance. Note a single public water system may have multiple violations, thus the total number of public water systems listed in Table 4 above may differ from the number outlined here.

3.1.3 REVISED TOTAL COLIFORM RULE: MONITORING & REPORTING VIOLATIONS

Under the Revised Total Coliform Rule, M&R violations are tracked separately as two different violations and not combined as a single M&R violation as they were under the 1989 Total Coliform Rule.

In 2023, the NJDEP issued 613 monitoring violations to 355 public water systems. As of May 8, 2024, 150 (42%) public water systems subsequently monitored properly and were returned to compliance. There were 750 reporting violations issued to 404 public water systems; as of May 8, 2024, 222 (55%) public water systems returned to compliance. Note that a single public water system may have incurred both monitoring and reporting violations, thus the total number of public water systems listed in Table 4 may be different from the number outlined here.

3.1.4 *REVISED TOTAL COLIFORM RULE: SAMPLE SITING PLAN VIOLATIONS*

Revised Total Coliform Rule Sample Siting Plans are required to be prepared and kept on site at all public water systems. NJDEP's Division of Water Enforcement program ensures that the Sample Siting Plan is available and representative of the public water system's distribution system. In 2023 three (3) violations were issued for failure to provide a Revised Total Coliform Rule Sample Siting Plan. In addition, NJDEP approved 4 Sample Siting Plans in 2023.

3.1.5 *REVISED TOTAL COLIFORM RULE: SEASONAL WATER SYSTEM-SPECIFIC VIOLATIONS*

Seasonal public water systems are a subcategory of noncommunity water systems established under the Revised Total Coliform Rule. A seasonal public water system is defined as a noncommunity water system that is not operated on a year-round basis and starts up and shuts down at the beginning and end of each operating season. A seasonal public water system may be more susceptible to water quality problems because the public water system is periodically inactive or depressurized. Seasonal public water systems are therefore required to demonstrate completion of a state-approved start-up procedure to ensure that the public water system is free of microbial contamination prior to the beginning of its operating season, and they must monitor monthly for the duration of their operating season. In 2023 there were 454 public water systems classified as seasonal public water systems in New Jersey. In 2023, 72 (16%) seasonal public water systems incurred a violation of their seasonal start up requirements.

In New Jersey, the start-up procedure requires all seasonal public water systems to collect a total coliform sample prior to opening. If the sample is positive for *E. coli* the public water system must have a Level 2 assessment conducted and if found, address significant deficiencies, prior to opening.

New Jersey ensures that seasonal public water systems follow this start-up procedure prior to opening their public water systems by reviewing both the start-up sample result and certification. Seasonal public water systems that do not provide a seasonal start-up sample receive a TT violation. Public water systems that collected a start-up sample prior to opening but did not submit their start-up certification on time receive a reporting violation. In 2023, 77 TT violations were issued to 72 public water systems for the failure to provide a seasonal start-up sample. As of May 8, 2024, 8 (11%) of the 72 public water systems with TT violations supplied the necessary information and returned to compliance. Table 5 breaks down violations by noncommunity water system type. Figure 6 illustrates the overall percentages of violations incurred by seasonal public water systems and Figure 7 illustrates the percentage of each type of violation incurred.

Table 5: Revised Total Coliform Rule Violations for Seasonal Public Water Systems Only by System Type for Treatment Techniques and Reporting incurred in 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPE*		TOTAL OF VIOLATIONS
	Treatment Technique	Reporting	
NONTRANSIENT NONCOMMUNITY	3 (3)	0	3
TRANSIENT NONCOMMUNITY	74 (69)	0	74
GRAND TOTAL	77 (72)	0	77

*Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

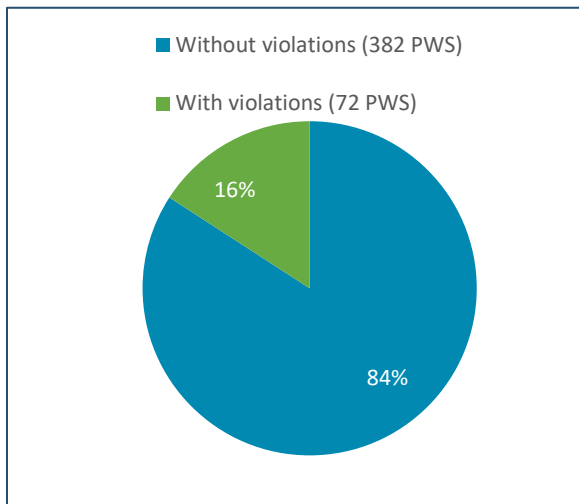


Figure 6: Percentage of Seasonal Public Water Systems (PWS) with and without Revised Total Coliform Rule seasonal specific Violations during 2023.

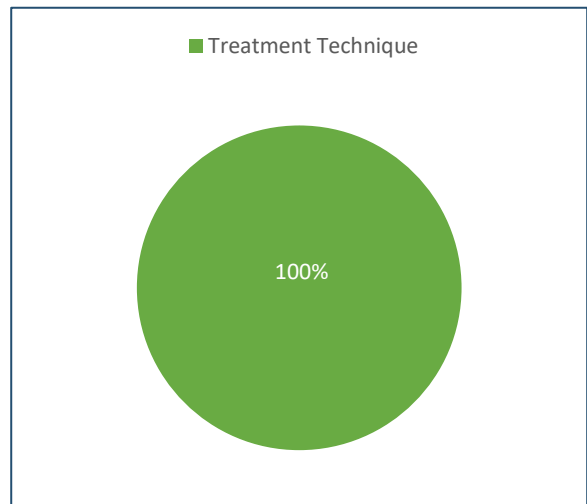


Figure 7: Percentage of types of seasonal specific violations incurred under the Revised Total Coliform Rule in 2023.

3.2 GROUND WATER RULE

The federal Ground Water Rule, effective December 1, 2009, was designed to increase protection against microbial pathogens, such as *E. coli* and viruses, in public water systems that use ground water sources. New Jersey has 3,391 public water systems that utilize a ground water source and must comply with this rule. The major provisions of the rule require triggered source water monitoring when total coliform is detected in the distribution system and periodic sanitary surveys to identify deficiencies that could lead to contamination.

Public water systems with *E. coli* in their source water are required to take corrective actions to reduce the risk from any identified deficiencies to protect drinking water consumers. Corrective

actions include, but are not limited to, removing the source of the contamination, drilling a new well, and/or installing 4-log treatment to ensure virus inactivation.

In 2023, 90 (3%) public water systems incurred a Ground Water Rule violation. Of that 3%, most of the violations were monitoring violations. Table 6 below lists the details for all violations incurred under the Ground Water Rule. Figure 8 illustrates the overall percentage of public water systems that incurred Ground Water Rule violations and Figure 9 depicts the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.2.1 and 3.2.2.

Table 6: Ground Water Rule Violations by System Type for Treatment Techniques, Monitoring, and Reporting for 2023.

TYPE OF SYSTEM	VIOLATION TYPE*			TOTAL OF VIOLATIONS
	Treatment Techniques	Monitoring	Reporting	
COMMUNITY	0	48 (30)	1 (1)	49
NONTRANSIENT NONCOMMUNITY	1 (1)	8 (8)	0	9
TRANSIENT NONCOMMUNITY	10 (10)	57 (40)	0	67
GRAND TOTAL	11 (11)	113 (78)	1 (1)	125

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

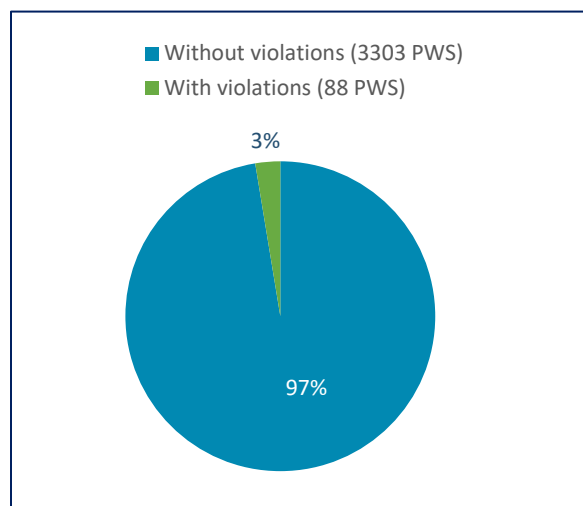


Figure 8: Percentage of Public Water Systems (PWS) with and without Ground Water Rule Violations during 2023.

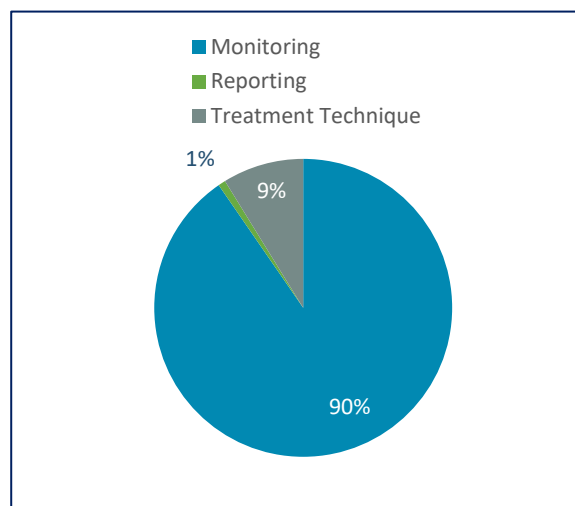


Figure 9: Percentage of types of violations incurred under the Ground Water Rule in 2023.

The Ground Water Rule was designed to work in parallel with the Revised Total Coliform Rule and trigger activities when total coliforms are found in a public water system’s distribution system; therefore, there are no established MCLs under the Ground Water Rule. All violations

under the Ground Water Rule are for failure to complete triggered activities or for failure to monitor as required.

3.2.1 *GROUND WATER RULE: TREATMENT TECHNIQUE VIOLATIONS*

Once a public water system has determined to have fecal contamination in their source, they are required to take corrective actions to remedy the contamination. Any public water system that fails to take corrective actions incurs a TT violation.

In 2023, the NJDEP issued 11 TT violations to 11 public water systems. As of May 8, 2024, nine (9) of these public water systems (82%) have addressed their source contamination and have been returned to compliance; of the remaining two (2) public water systems, one (1) has since returned to compliance and one (1) is completing corrective actions. The remaining public water system attempted to eliminate the source of contamination which was unsuccessful. The public water system is in the process of installing 4 log virus inactivation treatment.

3.2.2 *GROUND WATER RULE: MONITORING & REPORTING VIOLATIONS*

If total coliform is detected in the distribution system, source water monitoring is triggered. If subsequent triggered monitoring indicates that there is *E. coli* in a source, additional monitoring of the source is then required. If the additional monitoring indicates that the source is contaminated, a public water system is required to consult with the state regarding their proposed corrective actions, and then complete corrective actions to remedy the contamination.

If the additional monitoring does not confirm that the source is contaminated, New Jersey requires the public water system to conduct assessment monitoring of their source monthly for one (1) year to ensure that there is no contamination in the source. Failure to complete any of the above monitoring results in the issuance of an M&R violation.

In 2023, there were 75 M&R violations for failure to conduct triggered and/or additional monitoring issued to 60 public water systems; as of May 8, 2024, 13 (22%) of these public water systems subsequently monitored and/or reported properly and were returned to compliance. There were two (2) M&R violation for failure to conduct assessment monitoring issued to one (1) public water systems. As of May 8, 2024, this public water system has not returned to compliance.

In 2023, one (1) public water system failed to consult with the state and incurred a reporting violation; this public water system has subsequently returned to compliance.

3.3 DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: TOTAL TRIHALOMETHANES, TOTAL HALOACETIC ACIDS AND DISINFECTANT BY-PRODUCT PRECURSORS

The Stage 1 and Stage 2 Disinfectants and Disinfection Byproduct Rule applies to all community water systems and nontransient noncommunity water systems that add a chemical disinfectant to their drinking water treatment process or that deliver disinfected water that had been treated with a chemical disinfectant. The Stage 2 portion of the rule also requires public water systems to conduct monitoring for compliance with disinfection by-product MCLs. Stage 2 of the Disinfectants and Disinfection By-Product Rule built upon the original rule by requiring MCLs for disinfection by-products to be calculated at each location that is required to be monitored; this is known as a “locational running annual average.” Since disinfection by-products form and degrade over time and under varying conditions, having a locational running annual average increases the protection provided by the rule by ensuring that all parts of the public water system are compliant with the MCLs (as shown in the sidebar). The Stage 2 portion of the rule includes requirements that public water systems proactively identify problem areas within their distribution system by calculating operational evaluation levels, which are an estimated level of disinfection by-products based on three (3) quarters of monitoring results, plus an assumed fourth quarter result. If an operational evaluation level is exceeded, the public water system must perform an evaluation of their public water system and submit a report on any actions that they can proactively take to prevent a future MCL exceedance. Finally, the Stage 2 portion of the rule includes monitoring requirements at consecutive public water systems i.e. those public water systems that purchase all their treated water from another public water system and have no sources of their own, who were not required to monitor under the original Rule.

Disinfectants and Disinfection Byproduct Rule Maximum Contaminant Levels
Trihalomethanes (TTHM) 80 µg/l [ppb] running annual average. Total of Dichlorobromomethane, Chlorodibromomethane, Bromoform and Chloroform.
Haloacetic Acids (HAA5) 60 µg/l ppb running annual average. Total of Monochloroacetic, Dichloroacetic, Trichloroacetic, Bromoacetic and Dibromoacetic acids

The Stage 1 portion of the rule requires monitoring for disinfectant residuals at the same time and place as total coliform monitoring and sets a MRDL of 4.0 mg/l in the distribution system. Finally, the Stage 1 portion of the rule establishes monitoring and level criteria for disinfectant precursors at public water systems that use a surface water source, and licensed operator requirements for all community and nontransient noncommunity water systems that utilize a chemical disinfectant.

Any public water system that does not meet the established limits for disinfection by-products and/or disinfection residuals incurs an MCL and/or MRDL violation and any public water system that fails to complete the required monitoring incurs an M&R violation. Any public water

system that does not meet the disinfectant precursors criteria or fails to comply with the licensed operator provision incurs a TT violation. Any public water system that fails to prepare and submit an action report after exceeding an operational evaluation level incurs a reporting violation.

In New Jersey, 609 public water systems employ chemical disinfection and are regulated under the Disinfectants and Disinfection By-Product Rules. In 2023, 90 (15%) public water systems incurred a violation of the Disinfectants and Disinfection By-Product Rule requirements. Only 2% of violations incurred are MCL, 2% are TT, and there were no MRDL violations incurred in 2023. Table 7 below lists the details for all violations incurred under the Disinfectants and Disinfection By-Product Rules. Figure 10 illustrates the overall percentage of public water systems that incurred Disinfectants and Disinfection By-Product Rule violations and Figure 11 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.3.1 and 3.3.3.

Table 7: Disinfectant and Disinfection By-Product Rule Violations by System Type for Maximum Contaminant (MCL) Level Exceedances, Maximum Residual Disinfectant Levels (MRDL) Exceedances, Treatment Techniques (TT), Monitoring, and Reporting for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPE*					TOTAL OF VIOLATIONS
	MCL	MRDL	TT	Monitoring	Reporting	
COMMUNITY	3 (2)	0	4 (4)	151 (67)	2	160
NONTRANSIENT NONCOMMUNITY	0	0	0	38 (17)	0	38
GRAND TOTAL	3 (2)	0	4 (3)	189 (84)	2 (2)	198

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

3.3.1 *DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: MAXIMUM CONTAMINANT LEVEL & MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS*

In 2023, three (3) violations were issued for exceeding the TTHM and/or HAA5 MCL at two (2) public water systems. As of May 8, 2024, neither public water system met the MCL and have not returned to compliance. In 2023, there were no MRDL violations issued.

3.3.2 *DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: TREATMENT TECHNIQUE VIOLATIONS*

In 2023, four (4) TT violations were issued for not meeting disinfection residual requirements at three (3) public water systems. As of May 8, 2024, one (1) public water system met the requirements and returned to compliance.

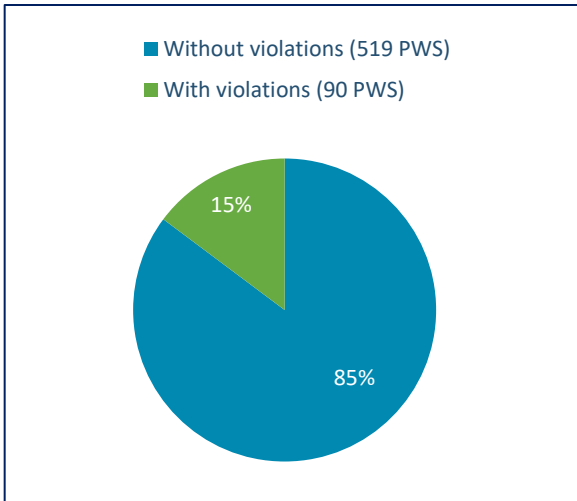


Figure 10: Percentage of Public Water Systems (PWS) with and without Disinfection Byproduct Rule Violations during 2023.

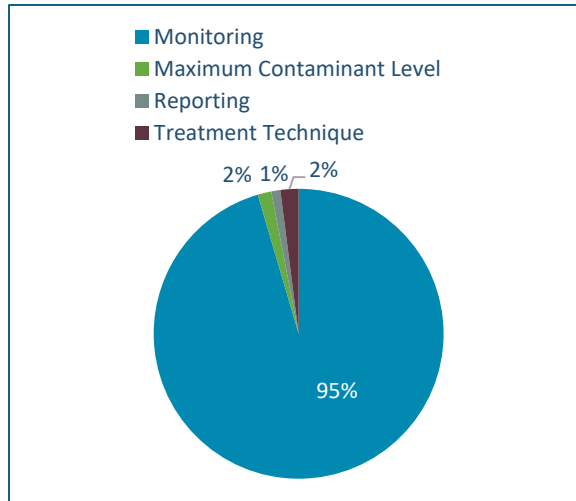


Figure 11: Percentage of types of violations incurred under the Disinfection Byproduct Rule in 2023.

3.3.3 *DISINFECTANTS AND DISINFECTION BY-PRODUCT RULE: MONITORING & REPORTING VIOLATIONS*

In 2023, the NJDEP issued 189 Monitoring violations at 84 public water systems. As of May 8, 2024, 34 (40%) public water systems subsequently monitored and/or reported properly and were returned to compliance.

In 2023, the NJDEP issued two (2) reporting violations to two (2) public water systems that exceeded an operational evaluation level and failed to prepare and submit the required Operational Evaluation Level Report. As of May 8, 2024, neither public water system has returned to compliance.

3.4 SURFACE WATER TREATMENT RULES

The Surface Water Treatment Rules establish treatment standards for public water systems that have surface water and/or groundwater under the direct influence of surface water



sources. The Surface Water Treatment Rules also apply to public water systems without their own sources that purchase surface water or groundwater under the direct influence of surface water.

Public water systems that use surface water or groundwater under the direct influence of surface water sources are required to use filtration and disinfection to achieve a minimum of 2 log removal and/or inactivation of *Cryptosporidium*, 3 log removal and/or inactivation of *Giardia lamblia* and 4 log removal and/or inactivation of viruses. For public water systems using conventional filtration or direct filtration, the turbidity level of representative samples of a public water system's filtered water must be less than or equal to 0.3 nephelometric turbidity units (NTU)

in at least 95 percent of the measurements taken each month and the turbidity level of the representative samples of a public water system's filtered water must at no time exceed 1 NTU. For public water systems that use slow-sand or diatomaceous earth filtration, the turbidity level of representative samples of a public water system's filtered water must be less than or equal to 1.0 NTUs in at least 95 percent of the measurements taken each month and the turbidity level of the representative samples of a public water system's filtered water must at no time exceed 5 NTU. Public water systems that use an alternative filtration method must demonstrate its effectiveness by meeting limits that are set by the state, but they can at no time exceed 1.0 NTUs in 95 percent of their monthly samples or 5 NTUs in any individual sample. Any public water system that exceeds these limits must identify the filter(s) which were operating at a sub-standard level by performing a filter profile, filter self-assessment and/or a comprehensive performance evaluation.

Public water systems that use surface water or groundwater under the direct influence of surface water sources are also required to continuously monitor for disinfection residuals at the entry point to their distribution system, and the disinfectant residuals cannot be <0.2 mg/L for more than four (4) hours. All surface water, groundwater under the direct influence of surface water and their purchasing public water systems must also monitor for disinfection residuals within the distribution system, and they must maintain a detectable residual in at least 95% of their samples.

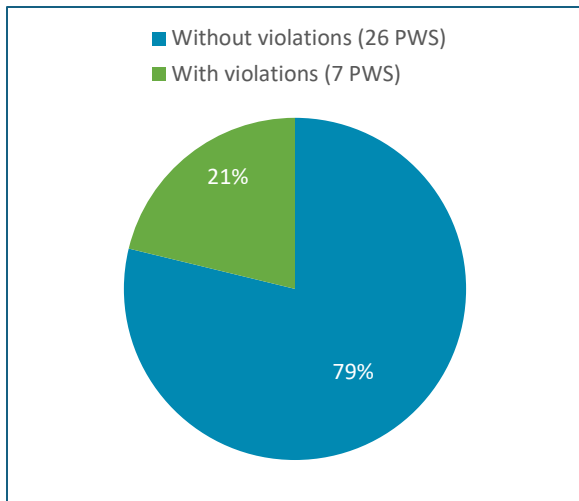


Figure 12: Percentage of Public Water Systems (PWS) with and without Surface Water Treatment Rule Violations During 2023.

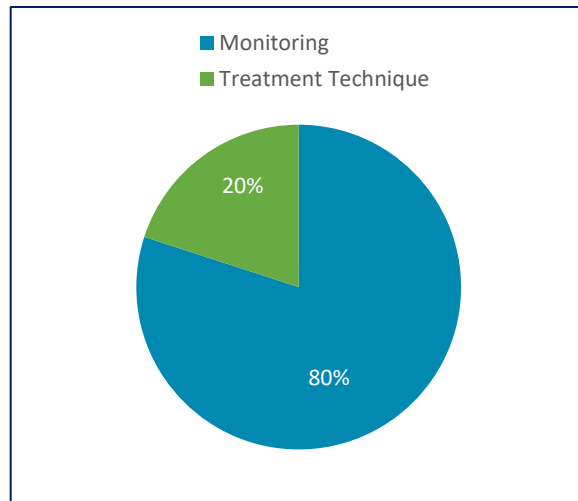


Figure 13: Percentage of Types of Violations Incurred Under the Surface Water Treatment Rule in 2023.

Since there are various ways of applying disinfection and multiple forms of filtration, the above limits are not considered MCLs. Any public water system that does not meet the disinfection and/or turbidity limits requirements incurs a TT violation.

Any public water system that fails to complete a required filter profile, filter self-assessment and/or a comprehensive performance evaluation incurs an M&R violation. Any public water system that fails to complete the required monitoring also incurs an M&R violation.

In New Jersey, 33 public water systems are regulated under the Surface Water Treatment Rules. In 2023, 21% of these public water systems incurred a Surface Water Treatment Rule violation. Table 8 lists the details for all violations incurred under the Surface Water Treatment Rule and the Long-Term Enhanced Surface Water Treatment Rule. Figure 12 depicts the overall percentage of public water systems that incurred Surface Water Treatment Rule violations and Figure 13 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.4.1 through 3.4.3.

Table 8: Surface Water Treatment Rule and Long-Term 2 Enhanced Surface Water Treatment Rule Violations by System Type for Treatment Techniques (TT) and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPE*		TOTAL OF VIOLATIONS
	TT	Monitoring	
COMMUNITY	0	8 (6)	8
NONTRANSIENT NONCOMMUNITY	2 (1)	0	2
GRAND TOTAL	2 (1)	8 (6)	10 (7)

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

3.4.1 SURFACE WATER TREATMENT RULE: TREATMENT TECHNIQUE VIOLATIONS

In 2023, two (2) TT violations were issued for not meeting the combined turbidity filter effluent limits at one (1) public water system. As of May 8, 2024, the Division is working with the public water system to assist them in returning to compliance. In 2023, New Jersey had 100% compliance with filter profile, filter self-assessment and/or a comprehensive performance evaluation requirement.

3.4.2 SURFACE WATER TREATMENT RULE: MONITORING & REPORTING VIOLATIONS

In 2023, four (4) M&R violations for failing to collect sufficient samples for chlorine were issued to two (2) public water systems; as of May 8, 2024, one (1) public water system has returned to compliance.

In 2023, two (2) M&R violations for failing to collect samples for turbidity were issued to two (2) public water systems; as of May 8, 2024, one (1) of these public water systems have returned to compliance. In 2023, one (1) M&R violation for failing to notify the State of a turbidity exceedance above 1 NTU was issued to one (1) public water system; as of May 8, 2024, the public water system has not returned to compliance.

3.4.3 LONG-TERM 2 ENHANCED SURFACE WATER TREATMENT RULE VIOLATIONS

The Long-Term 2 Enhanced Surface Water Treatment Rule was established to identify higher levels of pathogens in source water and requires any public water system that uses higher risk source waters to install additional treatment. All surface water and groundwater under the direct influence of surface water systems were required to monitor for *Cryptosporidium* and *Giardia* in their source(s) for two (2) rounds of monitoring, six (6) years apart and staggered by public water system population. Public water systems that served a population under 10,000 were allowed to monitor for *E. coli* as an indicator species for *Cryptosporidium*. Based on the results of their source water monitoring, public water systems were categorized into “Bins” with any higher-level Bins requiring additional treatment.

Any public water system that is required to install additional treatment and fails to do so incurs a treatment technique violation and any public water system that fails to complete the required Long-Term 2 Enhanced Surface Water Treatment Rule monitoring incurs an M&R violation. No M&R or TT violations were issued in 2023.

3.5 INORGANIC COMPOUNDS RULE

Inorganic contaminants are non-carbon-based compounds such as metals, nitrates, and asbestos. These contaminants are naturally occurring in some water, but can get into water through farming, chemical manufacturing, and other human activities. Table 9 lists the MCLs that USEPA has established for 15 inorganic contaminants; New Jersey has set a more stringent MCL for arsenic. Of the 15 regulated contaminants, only nitrate and nitrite have MCLs based on acute health-based levels. It should be noted that nitrite is only required to be sampled once during the first year that a public water system is in operation.

Asbestos is regulated on a nine (9) year compliance cycle, with the current cycle beginning in 2020 and ending in 2028. The federal regulations allow States to issue monitoring waivers for asbestos, and USEPA has approved NJDEP’s asbestos monitoring waiver program. 1003 waivers have been issued for asbestos monitoring for the current cycle. Waivers were not issued to public water systems located in areas of the state where asbestos could be naturally occurring in the geologic formations or to public water systems that have asbestos cement pipe in their inventory.

Any public water system that exceeds an inorganic MCL, incurs an MCL violation and any public water system that fails to complete the required monitoring incurs an M&R violation. Note that an inorganic chemical analysis includes up to 13 analytes and each missed sample is counted as a separate M&R violation.

In 2023, a total of 3,418 public water systems (excluding public water systems that are bulk purchase only) were required to monitor for nitrate. Of these, only 5% incurred a nitrate violation. Additionally, 33 public water systems were also required to monitor for nitrite as they have not done so before. Table 10 and Figure 14 show the overall nitrate violations incurred by public water systems by system type and percentage of public water systems that incurred violations. Figure 15 illustrates the percentage of each type of violation incurred.

Table 9: Maximum Contaminant Levels (MCLs) for Inorganic Compounds

Contaminant	MCL (µg/l)
Antimony	6
Arsenic	5 *
Asbestos	7 x 10 ⁶ fibers/l >10 µm
Barium	2,000
Beryllium	4
Cadmium	5
Chromium	100
Cyanide	200
Fluoride	4,000
Mercury	2
Nickel	+
Nitrate [as nitrogen]	10,000
Nitrite	1,000
[combined nitrate/nitrite]	10,000
Selenium	50
Thallium	2

+ No MCL – Monitoring Required

* N.J. MCL [A-280]

Table 10: Nitrate/Nitrite Violations by Public Water System Type for Maximum Contaminant (MCL) Level Exceedances, Treatment Techniques (TT), and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPES*			TOTAL OF VIOLATIONS
	MCL	TT	Monitoring	
COMMUNITY	1 (1)	1 (1)	17 (13)	19
NONTRANSIENT NONCOMMUNITY	3 (3)	2 (2)	16 (16)	21
TRANSIENT NONCOMMUNITY	6 (4)	2 (2)	140 (121)	148
GRAND TOTAL	10 (8)	5 (5)	173 (150)	188

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

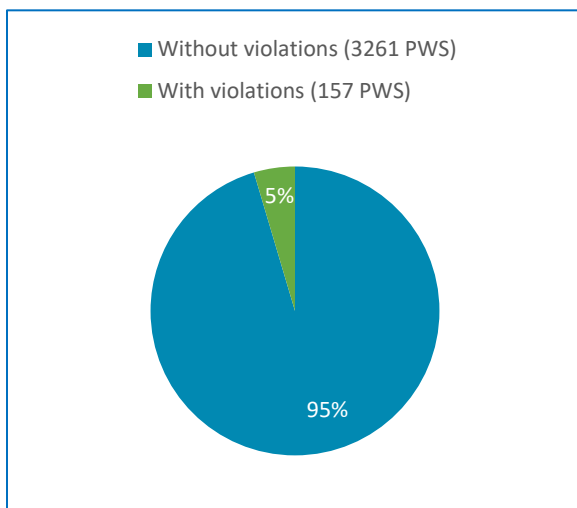


Figure 14: Percentage of Public Water Systems (PWS) with and without Nitrate Violations during 2023.

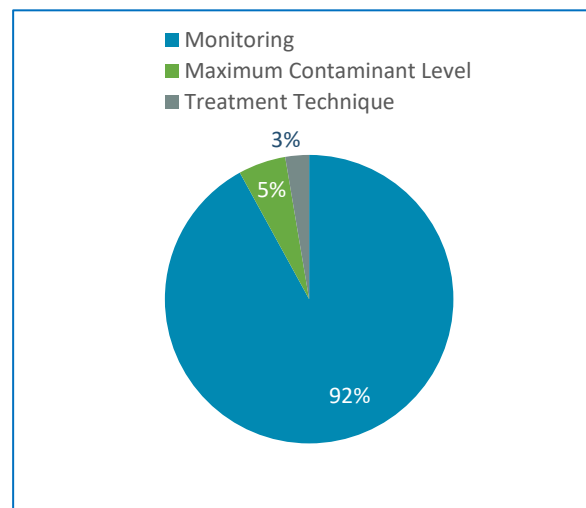


Figure 15: Percentage of types of violations incurred for Nitrate in 2023.

In 2023, a total of 1,124 public water systems were required to monitor for the additional contaminants regulated under the Inorganic Compound Rule. Of these, 1% incurred a violation. Table 11 provides details for all Inorganic Compound Rule violations, except nitrate, incurred by public water systems by system type.

Figure 16 illustrates the overall percentage of public water systems that incurred Inorganic Compound violations and Figure 17 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.5.1 through 3.5.3.

Table 11: Inorganic Compound Rule Violations (excluding Nitrate/Nitrite violations) by Public Water System Type for Maximum Contaminant (MCL) Level Exceedances, Treatment Techniques (TT), and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPES*			TOTAL OF VIOLATIONS
	MCL	TT	Monitoring	
COMMUNITY	0	0	10 (2)	10
NONTRANSIENT NONCOMMUNITY	0	0	2 (2)	9
TRANSIENT NONCOMMUNITY**	3 (1)	1 (1)	5 (3)	2
GRAND TOTAL	3 (1)	1 (1)	17 (7)	21

* Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

**Though the federal SDWA Inorganic Compound Rule does not apply to transient noncommunity systems, New Jersey requires transient noncommunity water systems that are child care center facilities to comply with the rule.

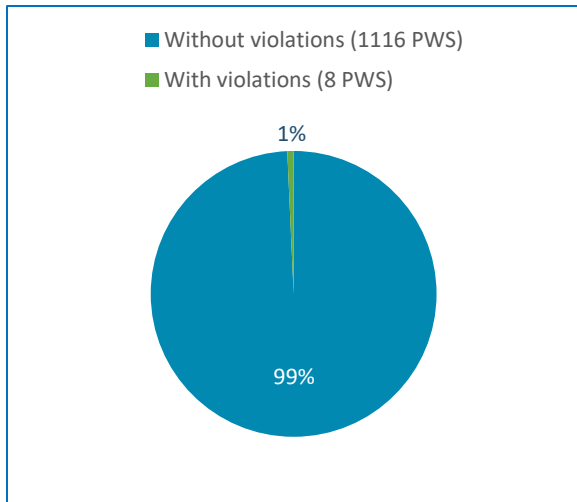


Figure 16: Percentage of Public Water Systems (PWS) with and without Inorganic Compound (excluding Nitrate) Violations during 2023.

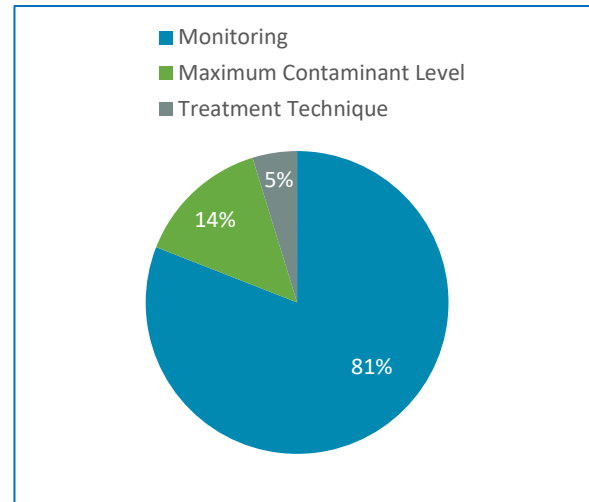


Figure 17: Percentage of types of violations incurred for Inorganic Compound (excluding Nitrate) in 2023.

3.5.1 INORGANIC COMPOUNDS: MAXIMUM CONTAMINANT LEVEL VIOLATIONS

In 2023 one (1) public water system failed to meet the MCL for arsenic. This public water system did not exceed the federal MCL. This public water system has returned to compliance as of May 8, 2024. No public water systems exceeded the MCL for any other inorganic compound during 2023.

3.5.2 INORGANIC COMPOUNDS: MONITORING & REPORTING VIOLATIONS

In 2023 there were 242 M&R violations issued to 34 public water systems; as of May 8, 2024, 22 (65%) of these public water systems subsequently monitored and/or reported properly and were returned to compliance. It should be noted, one (1) arsenic M&R violation was issued to one (1) transient water system, which is not a federal requirement. New Jersey requires these

public water systems to monitor on a quarterly basis because they have arsenic removal treatment. This transient system has subsequently monitored and returned to compliance. *Note these violations issued to transient systems are NOT reported to USEPA and are not found in the Enforcement and Compliance History Online tool.*

3.5.3 INORGANIC COMPOUNDS: TREATMENT TECHNIQUE VIOLATIONS

New Jersey has state regulations that require any public water system that installs a treatment device or process to bring their water into compliance with any applicable MCL to monitor for that contaminant on a quarterly frequency and maintain the treatment in good working order. Any public water system that fails to maintain their treatment as required incurs a state TT violation. *Note these violations are NOT reported to USEPA and are not found in the Enforcement and Compliance History Online tool.*

In New Jersey, 88 public water systems have treatment installed for nitrate removal. In 2023, five (5) state TT violations for failure to maintain a nitrate treatment system were issued to five (5) public water systems. As of May 8, 2024, three (3) public water systems have subsequently returned to compliance.

In New Jersey, 59 public water systems, including 16 transient noncommunity water systems, have treatment installed for arsenic removal. In 2023, one (1) state TT violations were issued to one (1) public water system for failure to maintain their arsenic removal system. As of May 8, 2024, this public water system has returned to compliance.



3.6 VOLATILE ORGANIC COMPOUNDS RULE

Volatile organic compounds are carbon-based, such as industrial solvents and pesticides. These contaminants generally get into water through runoff from cropland, discharge from factories and/or leaking underground storage tanks. Table 12 lists the MCLs that USEPA and New Jersey have established for 26 volatile organic compounds. As discussed in Section 2.3.2 above, New Jersey has set more stringent MCLs for 12 volatile organic compounds and has set MCLs for an additional five (5).

In 2023, a total of 1,127 public water systems, including 3 transient and non-public water systems that are child care center centers, were required to monitor for volatile organic compounds. Of these, only 3% incurred a violation; most of these violations were M&R violations. Table 13 provides details for all violations incurred under the Volatile Organic Compounds Rule and Figure 18 illustrates the overall percentage of public water systems that incurred Volatile Organic Compound Rule violations, and Figure 19 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.6.1 and 3.6.2.

Table 12: Maximum Contaminant Levels (MCLs) for Volatile Organic Compounds

Contaminant	MCL (µg/l)
Benzene	1 ^a
Carbon Tetrachloride	2 ^a
1,2-Dichlorobenzene	600
1,3-Dichlorobenzene	600 ^b
1,4-Dichlorobenzene	75
1,1-Dichloroethane	50 ^b
1,2-Dichloroethane	2 ^a
1,1-Dichloroethylene	2 ^a
cis-1,2-Dichloroethylene	70
trans-1,2-Dichloroethylene	100
1,2-Dichloropropane	5
Ethylbenzene	700
Methyl tertiary Butyl Ether	70 ^b
Methylene Chloride	3 ^a
Monochlorobenzene	50 ^a
Naphthalene	300 ^b
Styrene	100
1, 1,2,2-Tetrachloroethane	1 ^b
Tetrachloroethylene	1 ^a
Toluene	1,000
1,2,4-Trichlorobenzene	9 ^a
1,1,1-Trichloroethane	30 ^a
1,1,2-Trichloroethane	3 ^a
Trichloroethylene	1 ^a
Vinyl Chloride	2
Xylenes [Total]	1,000 ^a

^a Lower NJ MCL

^b NJ specific MCL, no EPA established MCL

Table 13: Volatile Organic Compound Rule Violations by Public Water System Type for Maximum Contaminant (MCL) Level Exceedances, Treatment Techniques (TT), and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPES*			TOTAL OF VIOLATIONS
	MCL	TT	Monitoring	
COMMUNITY	3 (1)	0	211 (10)	214
NONTRANSIENT NONCOMMUNITY	0	0	504 (20)	504
TRANSIENT NONCOMMUNITY	4 (2)	0	21 (1)	25
GRAND TOTAL	7 (3)	0	736 (31)	743

*Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

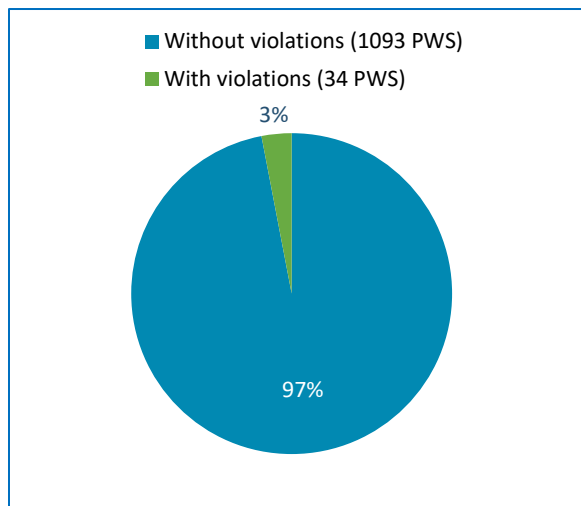


Figure 18: Percentage of Public Water Systems (PWS) with and without Volatile Organic Compound Rule Violations during 2023.

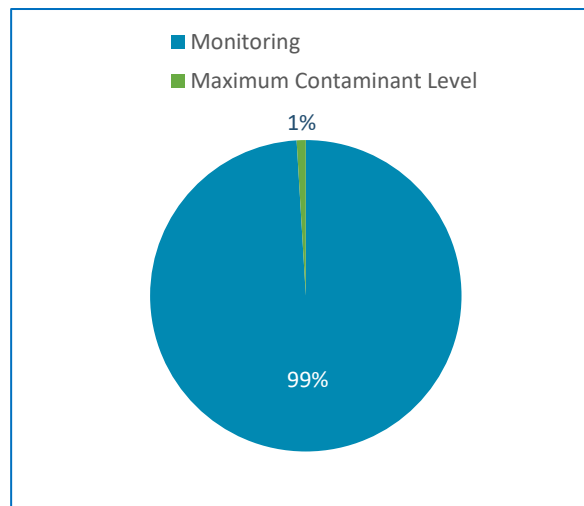


Figure 19: Percentage of types of violations incurred for Volatile Organic Compound Rule in 2023.

3.6.1 VOLATILE ORGANIC COMPOUNDS: MAXIMUM CONTAMINANT LEVEL VIOLATIONS

In 2023, the NJDEP issued four (4) MCL violations for exceeding the state limit for tetrachloroethylene at two (2) public water systems. One (1) of these public water systems did exceed the federal limit (5 µg/l) for this compound. As of May 8, 2024, one (1) public water system has returned to compliance. Three (3) additional MCL violations were issued to one (1) public water system, of which exceeded the state limit for benzene, and did not exceed the federal limit for benzene (5 µg/l). As of May 8, 2024, this public water system has not met the State or MCL limit and remains out of compliance. All the remaining volatile organic compound MCLs were met in 2023.

3.6.2 VOLATILE ORGANIC COMPOUNDS: MONITORING & REPORTING VIOLATIONS

If a public water system fails to collect the entire group of volatile organic compounds, as required under both federal and state SDWAs, although one (1) violation is issued to the public water system, 26 individual violations are created by the SDWIS/State data system and

reported to USEPA. There were 736 *individual* M&R violations issued to 31 public water systems in 2023; as of May 8, 2024, 24 (77%) public water systems subsequently monitored and/or reported properly and were returned to compliance.

3.6.3 VOLATILE ORGANIC COMPOUNDS: TREATMENT TECHNIQUE VIOLATIONS

In New Jersey, 154 public water systems have treatment installed for volatile organic compound removal. In 2023, there were no TT violations issued.

3.7 RADIOLOGICAL RULE

The Radiological Rule was established by USEPA to improve public health by reducing exposure to radionuclides in drinking water and thus reducing the risk of cancer. Radioactive particles occur both naturally in water and because of human activity. USEPA has established MCL limits for gross alpha particle activity (including radium-226 and excluding radon and uranium), combined radium 226/228, beta photon emitters, and uranium as shown in the sidebar.

Radiological Maximum Contaminant Levels

- Combined radium 226/228 = 5 picocuries/l (pCi/l);
- Gross alpha particle radioactivity (including radium 226 but excluding radon and uranium) = 15 pCi/l;
- Uranium = 30 µg/l.
- New Jersey has determined that there are no public water systems in the state that are vulnerable to beta photon emitters and therefore does not require monitoring.

In 2023, a total of 1,129 public water systems, including all nontransient noncommunity water systems, and five (5) transient noncommunity child care centers were required to monitor for radionuclides. Of these, only 5% incurred a violation, the majority of which were M&R

violations. Table 14 provides details for all violations incurred under the Radiological Rule. Figure 20 illustrates the overall percentage of public water systems that incurred Radiological Rule violations, and Figure 21 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.7.1 and 3.7.4.

Table 14: Radiological Rule Violations by System Type for Maximum Contaminant (MCL) Level Exceedances, Treatment Techniques (TT), and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPES*			TOTAL OF VIOLATIONS
	MCL	TT	Monitoring	
COMMUNITY	9 (3)	0	86 (12)	95
NONTRANSIENT NONCOMMUNITY	24 (8)	10 (2)	156 (30)	190
TRANSIENT NONCOMMUNITY	0	0	5 (1)	5
NONPUBLIC	3 (1)	0	5 (1)	8
GRAND TOTAL	36 (12)	10 (2)	252 (44)	298

*Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

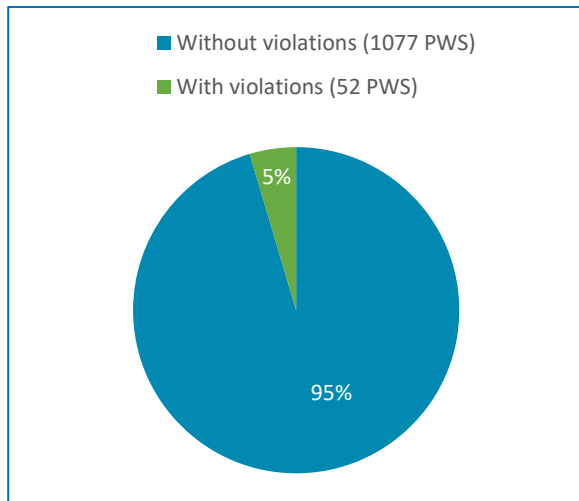


Figure 20: Percentage of Public Water Systems (PWS) with and without Radiological Rule Violations during 2023.

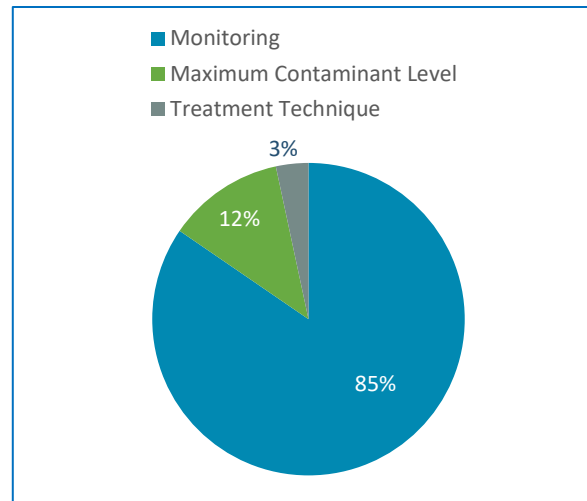


Figure 21: Percentage of types of violations incurred for Radiological Rule in 2023.

3.7.1 RADIOLOGICAL RULE ANALYTICAL TECHNIQUE

Samples from wells drawing from New Jersey’s Cohansey aquifer, located in southern New Jersey, have shown elevated levels of naturally occurring radioactivity, with a significant portion of the gross alpha particle activity detected due to the presence of radium 224, a radionuclide with a half-life of 3.7 days. Since there is no federal or state standard for radium 224, the NJDEP requires the analysis of drinking water samples for gross alpha particle activity by Standard Method ECLS-R-GA Rev 8, which requires analysis within 48 hours and captures radium 224 activity, instead of up to a year after collection, as allowed by the federal Radiological Rule.

3.7.2 RADIOLOGICAL RULE: MAXIMUM CONTAMINANT LEVEL VIOLATIONS


In 2023, NJDEP issued 33 MCL violations for combined radium, gross alpha and combined uranium at eleven (11) public water systems. As of May 8, 2024, four (4) of these public water systems have met the MCL and returned to compliance. The Division is working with the remaining public water systems to assist them in returning to compliance.

3.7.3 RADIOLOGICAL RULE: MONITORING & REPORTING VIOLATIONS

In 2023, there were 252 M&R violations issued to 44 public water system; as of May 8, 2024, 30 (68%) public water systems subsequently monitored and/or reported properly and were returned to compliance. 156 of these M&R violations were issued to 30 nontransient noncommunity water systems. *Note the federal Radiological Rule does not apply to nontransient noncommunity water systems. New Jersey requires nontransient noncommunity water systems to monitor for radiologicals under N.J.A.C. 7:10-5.2, and issues state violations for these requirements. These violations will not be found in the Enforcement and Compliance History Online tool.*

3.7.4 RADIOLOGICAL RULE: TREATMENT TECHNIQUE VIOLATIONS

In New Jersey, 90 community and nontransient noncommunity water systems have treatment installed for radionuclide removal. In 2023, ten (10) state TT violations for individual radiological analytes were issued to two (2) public water systems for failure to maintain radiological removal. As of May 8, 2024, one (1) public water system has returned to compliance. *Note these violations are state violations and are NOT reported to USEPA; these violations are not found in the Enforcement and Compliance History Online tool.*

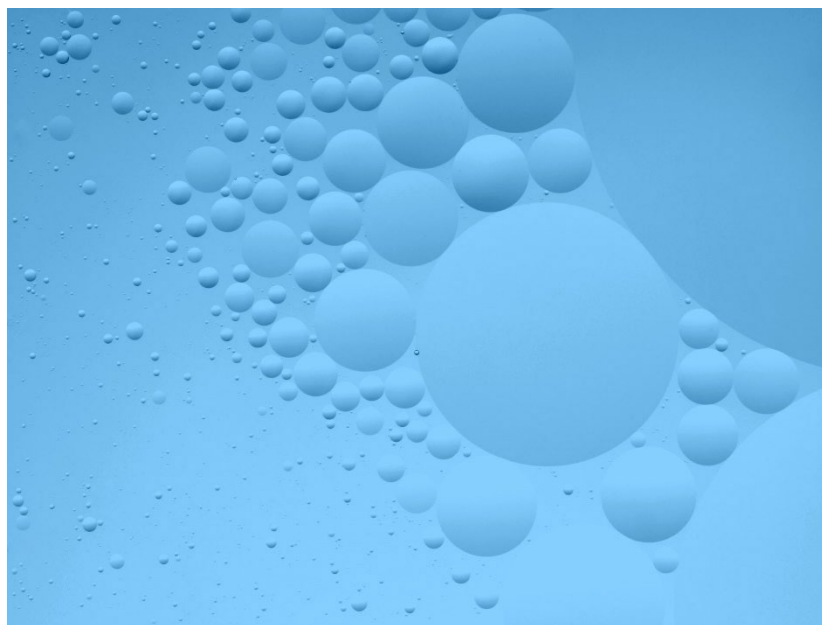

3.8 SYNTHETIC ORGANIC COMPOUNDS RULE

USEPA has established monitoring requirements for 33 synthetic organic compounds and MCLs for 30 synthetic organic compounds, and New Jersey has established state monitoring requirements and an MCL for an additional synthetic organic compound, 1,2,3-trichloropropane, which became effective in 2019. Table 15 lists the MCLs that USEPA and New Jersey have established for synthetic organic compounds.

According to the federal SDWA, every three (3) years community and nontransient noncommunity water systems are required to either sample their finished water for synthetic organic compounds or obtain a state-issued waiver from sampling. Synthetic Organic Compound Sampling Waivers are based on the use of the synthetic organic compounds in New Jersey and/or the susceptibility of the water sources to contamination. In accordance with criteria established in New Jersey's USEPA-approved synthetic organic compound waiver program groundwater systems were required to submit a "New Jersey Well Vulnerability Survey for Obtaining a Pesticide and/or SOC Waiver" (Survey) prior to the end of 2023 in order to participate in the 2023-2025 waiver compliance period. Based on Survey non-submittals, 11 public water systems were required to monitor all synthetic organic compounds starting Q1

2024. This is in addition to 18 public water systems that were required to monitor for one or more SOCs during 2023 based on prior detections or vulnerability.

Note that the SOC waiver program does not currently include Dibromochloropropane (DBCP), Ethylene Dibromide (EDB), and 1,2,3-Trichloropropane (1,2,3-TCP), and that all community and nontransient noncommunity water systems are required to monitor for these compounds at some frequency. The SOC waiver program also does not include PFAS, as PFAS are not part of the USEPA Phase II/V Rule.

Any water public water system that exceeds a Synthetic Organic Compound Rule MCL incurs an MCL violation and any public water system that fails to complete the required monitoring incurs an M&R violation. Details concerning violations incurred under the Synthetic Organic Compounds Rule are listed in Table 16. Figure 22 depicts the overall percentage of public water systems that incurred Synthetic Organic Compound Rule violations, and Figure 23 depicts the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.8.1 and 3.8.2.

Table 15: Maximum Contaminant Levels (MCLs) for Synthetic Organic Compounds

Contaminant	MCL (ug/l)
Alachlor	2
Aldicarb	+
Aldicarb Sulfone	+
Aldicarb Sulfoxide	+
Atrazine	3
Benzo[a]pyrene	0.2
Carbofuran	40
Chlordane	0.5*
Dalapon	200
Dibromochloropropane [DBCP]	0.2
Di[2-ethylhexyl]adipate	400
Di[2-ethylhexyl]phthalate	6
Dinoseb	7
Diquat	20
Endothall	100
Endrin	2
Ethylene dibromide [EDB]	0.05
Glyphosate	700
Heptachlor	0.4
Heptachlor Epoxide	0.2
Hexachlorobenzene	1
Hexachlorocyclopentadiene	50
Lindane (BHC-Gamma)	0.2
Methoxychlor	40
Oxamyl	200
PCBs	0.5
Pentachlorophenol	1
Picloram	500
Simazine	4
Toxaphene	3
2,3,7,8—TCDD [Dioxin]	3x10 ⁻⁵
2,4-D	70
2,4,5-TP [Silvex]	50
1,2,3-Trichloropropane (1,2,3-TCP)	0.030*

* NJ MCL

+ No MCL – Monitoring Required

Table 16: Synthetic Organic Compounds Rule Violations by System Type for Maximum Contaminant (MCL) Level Exceedances and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPE		TOTAL OF VIOLATIONS
	MCL	Monitoring	
COMMUNITY	0	71 (17)	71
NONTRANSIENT NONCOMMUNITY	0	57 (12)	57
TRANSIENT NONCOMMUNITY	0	3 (1)	3
GRAND TOTAL	0	131 (30)	131

*Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

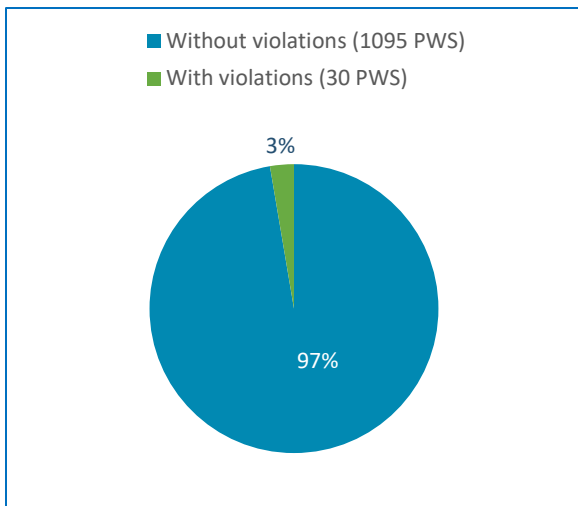


Figure 22: Percentage of Public Water Systems (PWS) with and without Synthetic Organic Compound Rule Violations during 2023.

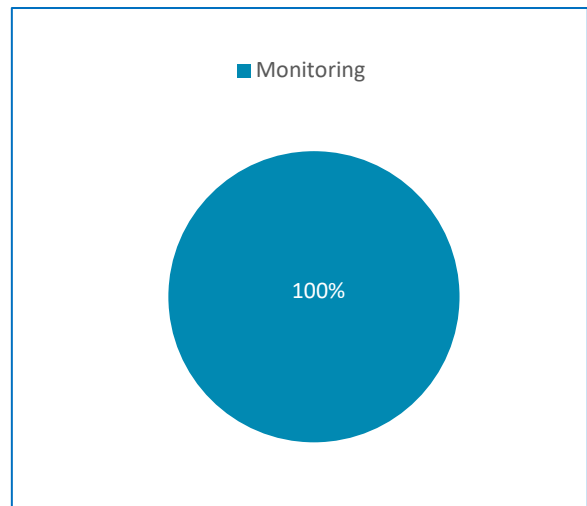


Figure 23: Percentage of types of violations incurred for Synthetic Organic Compound Rule in 2023.

3.8.1 SYNTHETIC ORGANIC COMPOUNDS RULE: MAXIMUM CONTAMINANT LEVEL VIOLATIONS

In 2023, no MCL violations were issued for exceedance of the Synthetic Organic Compounds Rule MCL for 1,2,3-TCP and DEHP.

3.8.2 SYNTHETIC ORGANIC COMPOUNDS RULE: MONITORING & REPORTING VIOLATIONS

In 2023, there were 131 M&R violations issued to 30 public water systems for EDB, DBCP and/or 1,2,3-TCP; as of May 8, 2024, 15 (50%) public water systems subsequently monitored and/or reported properly and were returned to compliance.

3.8.3 SYNTHETIC ORGANIC COMPOUNDS RULE: TREATMENT TECHNIQUE VIOLATIONS

In New Jersey, seven (7) community and nontransient noncommunity public water systems have treatment installed for 1,2,3-TCP and EDB removal; there are no treatment systems for the removal of DBCP in New Jersey. All seven (7) of these public water systems properly maintained their treatment systems and no state TT violations were issued.

3.9 PER- AND POLYFLUOROALKYL SUBSTANCES

Perfluorooctanoic acid (PFOA), Perfluorooctanesulfonic acid (PFOS), and Perfluorononanoic acid (PFNA) are per- and polyfluoroalkyl substances (PFAS), previously referred to as perfluorinated compounds (PFCs), that are man-made and used in industrial and commercial applications. PFOA was used as a processing aid in the manufacture of fluoropolymers used in non-stick cookware and other products, as well as other commercial and industrial uses, based on its resistance to harsh chemicals and high temperatures. PFOS is used in metal plating and finishing as well as in various commercial products. Both PFOA and PFOS have been used in aqueous film forming foams for firefighting and training, and both compounds are found in consumer products such as stain resistant coatings for upholstery and carpets, water resistant outdoor clothing, and grease proof food packaging. PFNA has been historically used as a processing aid in the manufacturing of high-performance plastics that are resistant to harsh chemicals and high temperatures.

These compounds have been detected in drinking water supplies in New Jersey and pose serious health threats to consumers. PFOA, PFOS, and PFNA accumulate in the human body, and exposure to low concentrations of the contaminants in drinking water increases concentrations in human blood serum that persist for many years after exposure ends. Table 17 lists the MCLs that have been established for these compounds.

Table 17: Maximum Contaminant Levels (MCLs) Per- And Polyfluoroalkyl Substances

Contaminant	MCL (µg/l)
Perfluorooctanoic acid (PFOA)	0.014
Perfluorooctanesulfonic acid (PFOS)	0.013
Perfluorononanoic acid (PFNA)	0.013

In 2023, a total of 1,138 public water systems were required to monitor for PFAS chemicals, including 14 transient and non-public water systems that are child care center centers. Of these, 9% incurred a violation. Table 18 provides details for all PFAS violations incurred, Figure 24 illustrates the overall percentage of public water systems that incurred PFAS violations, and Figure 25 illustrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.9.1 and 3.9.2.

Table 18: Per- and Polyfluoroalkyl Substances Violations by System Type for Maximum Contaminant (MCL) Level Exceedances and Monitoring for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPE			TOTAL OF VIOLATIONS
	MCL	TT	Monitoring	
COMMUNITY	239 (27)	0	156 (33)	395
NONTRANSIENT NONCOMMUNITY	42 (16)	0	87 (22)	129
TRANSIENT NONCOMMUNITY	1 (1)	0	18 (4)	19
NON-PUBLIC	0	0	3 (1)	3
GRAND TOTAL	282 (44)	0	264 (60)	546

*Numbers in parenthesis indicate the count of systems incurring the specified violations.

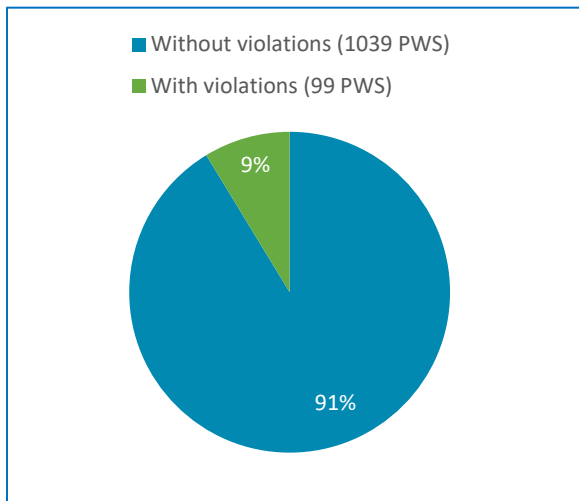


Figure 24: Percentage of Public Water Systems (PWS) with and without Perfluorononanoic Acid Rule Violations during 2023.

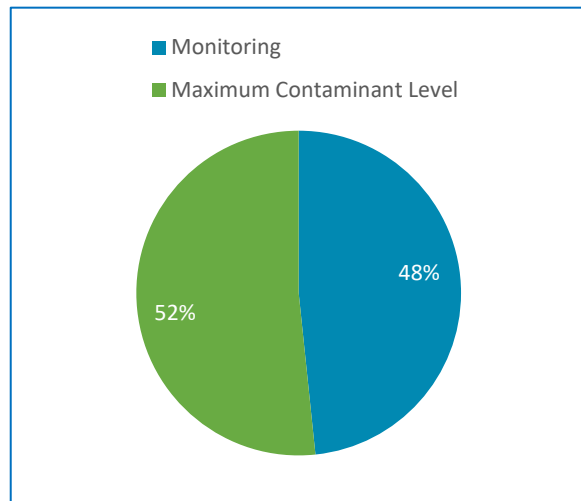


Figure 25: Percentage of types of violations incurred for Perfluorononanoic Acid Rule in 2023.

3.9.1 *PER- AND POLYFLUOROALKYL SUBSTANCES: MAXIMUM CONTAMINANT LEVEL VIOLATIONS*

In 2023, the NJDEP issued 282 MCL violations for exceeding the state MCL for one of the PFAS chemicals at 44 public water systems. As of May 8, 2024, 15 (34%) of these public water systems have been returned to compliance. Three (3) have connected to community water systems, one (1) has been reclassified, 10 have installed treatment, and one (1) is in the process of installing treatment. The Division continues to work with the remaining public water systems to assist them in returning to compliance.

3.9.2 *PER- AND POLYFLUOROALKYL SUBSTANCES: MONITORING & REPORTING VIOLATIONS*

In 2023, the NJDEP issued 264 M&R violations to 60 public water systems. As of May 8, 2024, 21 (35%) public water systems subsequently monitored and/or reported properly and were returned to compliance.

3.9.3 *PER- AND POLYFLUOROALKYL SUBSTANCES: TREATMENT TECHNIQUE VIOLATIONS*

In New Jersey 49 community and nontransient noncommunity public water systems have treatment installed for PFAS substances. In 2023, the NJDEP issued no TT violations.

3.10 LEAD AND COPPER RULE

The Lead and Copper Rule was first published by USEPA in 1991 to control lead and copper in drinking water. Since 1991, USEPA has revised the rule to enhance implementation in the areas of monitoring, treatment, customer awareness, and lead service line replacement. The Lead

and Copper Rule is applicable to all community and nontransient noncommunity water systems and the rule established action levels (ALs) for both lead and copper. An AL is similar to an MCL, but a violation is not incurred if the AL is exceeded; exceeding the AL (at the 90th percentile level of samples collected) triggers activities that must be conducted, such as monitoring for water quality parameters, conducting corrosion control studies, the installation of corrosion control treatment and the issuance of public education. Once corrosion control treatment has been installed, the Division sets system-specific optimal water quality parameter limits, and the public water system is required to operate within the set limits. If a public water system fails to complete any of these required activities or does not meet their system-specific water quality parameter limits, they incur a TT violation, an M&R violation, or a separate reporting violation.

The Lead and Copper Rule also established specific criteria for the selection of sample sites within the distribution system. A tiered approach is used with the highest tier targeting those locations most vulnerable to lead leaching out of the pipes. These “Tier 1” locations are identified by the presence of lead plumbing, copper pipes with lead solder installed after 1982, or the presence of lead service lines.

The federal Lead and Copper Rule requires public education to be sent to all customers no later than 60 days after the end of the monitoring period in which a lead action level exceedance occurred. It should be noted that New Jersey has enacted legislation that now requires public education to be delivered within 10 days of the public water system becoming aware they have exceeded the action level for lead. A public water system that fails to issue public education incurs a TT violation. The federal rule also requires a Lead Consumer Notice to be sent to each consumer that was sampled for lead and copper, and a public water system that fails to prepare and distribute their Lead Consumer Notices incurs a reporting violation.

In 2023 a total of 1,213 public water systems were required to comply with the Lead and Copper Rule, including an additional nine (9) transient noncommunity water systems and two (2) non-public water systems that are child care centers. Of these public water systems, 31% incurred a violation under the Lead and Copper Rule. Table 18 provides details for all violations incurred under the Lead and Copper Rule. Figure 26 demonstrates the overall percentage of public water systems that incurred Lead and Copper Rule violations, and Figure 27 demonstrates the percentage of each type of violation incurred. Further details concerning each type of violation are provided in Sections 3.9.1 through 3.9.5.

Table 19: Lead and Copper Rule Violations by System Type for Action Level Exceedances (ALEs), Treatment Techniques (TT), Monitoring, and Reporting for 2023.

TYPE OF PUBLIC WATER SYSTEM	VIOLATION TYPES*					TOTAL OF VIOLATIONS
	Lead ALEs	Copper ALEs	TT	Monitoring	Reporting	
COMMUNITY	5 (5)	5 (5)	43 (35)	139 (97)	89 (72)	281
NONTRANSIENT NONCOMMUNITY	18 (18)	11 (11)	40 (33)	130 (84)	155 (133)	352
TRANSIENT NONCOMMUNITY	0	1 (1)	1 (1)	8 (4)	0	10
GRAND TOTAL	23 (23)	17 (17)	84 (69)	277 (185)	244 (205)	645

*Numbers in parenthesis indicate the count of public water systems incurring the specified violations.

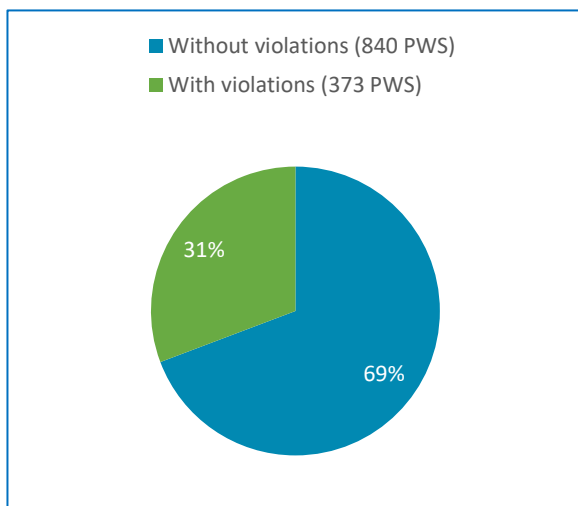


Figure 26: Percentage of Public Water Systems (PWS) with and without Lead and Copper Rule Violations during 2023.

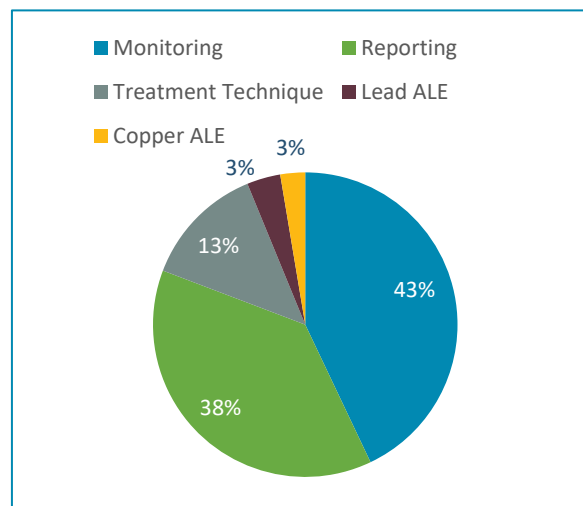


Figure 27: Percentage of types of violations incurred under the Lead and Copper Rule in 2023.

3.10.1 LEAD AND COPPER RULE: ACTION LEVEL EXCEEDANCES

In 2023, the lead AL was exceeded during 23 monitoring events at 23 public water systems, and the copper AL was exceeded during 17 monitoring events at 17 public water systems, including one (1) transient child care centers. Three (3) of these public water systems exceeded both the lead and the copper ALs. As of May 8, 2024, one (1) of these public water systems have returned to compliance. The remaining public water systems are continuing to work towards compliance by conducting water quality parameter monitoring, conducting corrosion control studies, and/or installing corrosion control treatment.

3.10.2 LEAD AND COPPER RULE: TREATMENT TECHNIQUE VIOLATIONS

In 2023, 84 TT violations were issued at 69 public water systems for violations under the Lead and Copper Rule. In 2023, 279 public water systems, including 2 child care centers, were required to conduct monitoring for optimal water quality parameters. Of the 84 TT violations,

62 were issued for failure to maintain optimal water quality parameters at 49 public water systems, including 1 child care center. One (1) TT violation was issued to a public water system for failure to comply with the lead service line replacement requirements and the public water system has subsequently returned to compliance. One (1) of the TT violations was issued for the failure to provide public education. The remaining twenty (20) TT violations were for failure to recommend or install corrosion control treatment. As of May 8, 2024, 22 (32%) public water systems have completed the required activity for their respective TT violation and have returned to compliance.

3.10.3 LEAD AND COPPER RULE: MONITORING & REPORTING VIOLATIONS

In 2023, 521 M&R violations were issued to 339 public water systems. 32 violations at 31 public water systems were issued for failing to collect lead and copper tap samples. 236 violations at 160 public water systems were issued for failing to conduct water quality parameter sampling. Nine (9) violations at eight (8) public water systems were issued for failure to conduct source water monitoring. As of May 8, 2024, 130 (38%) public water systems have completed the required monitoring and have returned to compliance. 244 of the total M&R violations were for failing to provide Lead Consumer Notices, at 205 public water systems. As of May 8, 2024, 112 (55%) of those public water systems completed the required notifications and have returned to compliance.

3.10.4 LEAD AND COPPER RULE: CHILD CARE SYSTEMS

Although the federal Lead and Copper Rule does not apply to transient noncommunity water systems or to non-public water systems, if the public water system is a child care center, New Jersey holds them to the same standards as a nontransient noncommunity water system. As detailed above, six (6) of these public water systems were issued violations under the LCR in 2023 and one (1) of them have returned to compliance. *Note that these violations are NOT reported to USEPA and are not found in the Enforcement and Compliance History Online tool.*

3.11 PUBLIC NOTIFICATION

Any public water system that incurs a violation of a national primary drinking water regulation must give notice to its consumers. Public notification requirements are divided into three (3) tiers that take into account the seriousness of the violation and the potential for adverse health effects. Tier 1 notices are required for all acute violations i.e., violations that have significant potential for adverse health effects as a result of short-term exposure; tier 2 notices are required for all other violations that could result in adverse health effects and tier 3 notices are required for any other violation, i.e., monitoring and/or reporting violations. The Division works with public water systems that are required to issue tier 1 public notifications to ensure that the mandatory language is incorporated in the public notification. Any public water system that fails to prepare and deliver the appropriate tier public notification incurs a violation.

In addition to the federal requirements, New Jersey requires that tier 1 public notice be reported to local authorities within 1 hour (see section 3.13.4) and that notices be provided in alternate languages as appropriate for the community's demographics.

In 2023, 106 violations were issued to 77 public water systems for failing to provide a public notification to its consumers after the incurrence of a violation. As of May 8, 2024, 58 public water systems (75%) have provided the required public notification and have returned to compliance. In late 2023 NJDEP began to enhance our oversight of tier 2 public notification more consistently resulting in the higher number of violations issued.

3.12 CONSUMER NOTIFICATION VIOLATIONS

The Consumer Confidence Report Rule requires all community water systems to prepare and distribute an annual water quality report summarizing information regarding source water, detected contaminants, compliance, and educational information applicable to their public water system. The report must be delivered annually to their customers by July 1st and by October 1st a certification, along with a copy of the Consumer Confidence Report, must be submitted to the state showing that it was delivered to their customers. The Consumer Confidence Report must contain data for the preceding year in a format that is detailed in federal and state regulations. New Jersey conducts a review of Consumer Confidence Reports submitted by any public water system that had MCL violations in the previous reporting year. Any public water system that fails to prepare and deliver a Consumer Confidence Report to their customers by July 1st of each year or submits a report with deficient content incurs a reporting violation.

In 2023, 61 reporting violations for failing to provide a Consumer Confidence Report to their customers by July 1, 2023 and 20 violations were incurred for providing a CCR with deficient content were issued to 56 community water systems; including four (4) community water systems that carried over violations from previous years. As of May 8, 2024, 46 of these 56 community water systems (82%) have correctly prepared the required Consumer Confidence Reports and distributed the report to their customers and have returned to compliance.

3.13 ADDITIONAL REQUIREMENTS IN NEW JERSEY

In addition to the state-specific monitoring and MCL requirements discussed above, there are several other requirements that New Jersey holds public water systems accountable for through the New Jersey SDWA. In 2023, New Jersey issued 422 state TT and Reporting violations to 1919 public water systems.

3.13.1 COMPLIANCE IN 1-YEAR (TT)

The New Jersey SDWA requires any public water system that exceeds a federal or state MCL to take any action necessary to bring the water into compliance with the applicable MCL within one (1) year after receipt of the sample results that demonstrated an exceedance of the MCL. Public water systems incur a state-type TT violation if they fail to return to compliance with the MCL within the one (1) year timeframe.

In 2023, the NJDEP issued 37 violations to 30 public water systems for failing to bring the water back into compliance with an MCL. As of May 8, 2024, six (6) public water systems (20%) have

completed measures to bring their public water system back into compliance with the MCL and the remaining 24 public water systems have been referred to the NJDEP's Division of Water Enforcement, and 13 have entered into an Administrative Consent Order.

3.13.2 REMEDIAL MEASURES REPORTING REQUIREMENTS

Pursuant to N.J.S.A. 58:12A-4, the Division previously required any public water system that violated a federal or state MCL to submit a Remedial Measures Report (RMR) within 30 days of notification of the violation. In the Remedial Measures Report, a public water system would outline any measure it takes, or proposes to be taken, to bring the public water system back into compliance. Public water systems would incur a state-type reporting violation if they fail to submit an RMR. The Division has since reviewed and revised its compliance policies and is no longer issuing violations related to the submission of RMRs.

In 2023, the NJDEP issued 7 reporting violations to 5 public water systems for failing to submit a RMR. As of May 8, 2024, all water systems have submitted RMRs and returned to compliance.

3.13.3 LEAD SERVICE LINE INVENTORY REPORTING REQUIREMENTS

All 561 community water systems were required to submit updated counts of service lines to the NJDEP by July 22, 2023. The Division issued 69 reporting violations to 69 (12%) community water systems for failing to submit an updated Lead Service Line Inventory. As of May 8, 2024, 40 (58%) community water systems have returned to compliance.

All community water systems were required to submit a lead service line replacement progress report, and a lead service line identification and replacement plan to the DEP by July 22, 2023. The Division issued 79 reporting violations to 79 (14%) community water systems for failing to submit the Lead Service Line Replacement Progress Report. As of May 8, 2024, 40 (50%) community water systems have returned to compliance. The Division issued 115 reporting violations to 115 (20%) community water systems for failing to submit the Lead Service Line Identification and Replacement Plan. As of May 8, 2024, 55 (48%) community water systems have returned to compliance.

3.13.4 NOTIFICATION OF TIER 1 WITHIN 1 HOUR REPORTING REQUIREMENTS

Any public water system that incurs a situation requiring the issuance of a Tier 1 public notice must directly contact the mayor(s) and municipal clerk(s) of each affected municipality by telephone and electronic mail within 1 hour of becoming aware of the situation, per N.J.S.A. 12A-8.2. Public water systems incur a state-type reporting violation if they fail to notify the appropriate officials within a 1-hour timeframe. In 2023, the NJDEP issued one (1) reporting violations to one (1) public water system for failure to comply with this requirement. As of May 8, 2024, this public water system has submitted their public notice certification and returned to compliance.

Appendix A: List of All Safe Drinking Water Act Violation Types with Federal Reporting Codes

Note that not all the below violation types were incurred by public water systems during the January 1, 2023 through December 31, 2023 time period.

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
01	Inorganic Compounds, Volatile Organic Compound, Radiological, Synthetic Organic Compounds	MCL	MCL, Single Sample	Any Regulated Contaminant		Failure to comply with the Maximum Contaminant Level (MCL) for any analyte set forth in 40 CFR 141 where a single sample causes the running annual average to exceed the MCL.
1A	Revised Total Coliform Rule	MCL	MCL, E. Coli (Revised Total Coliform Rule)	E Coli	3014	Failure to comply with the Maximum Contaminant Level (MCL) for total coliforms, including repeat sample collection and speciation requirements, as set forth in 40 CFR 141.860(a).
1H	State Rule	Reporting	Notification of Tier 1 within 1 Hour	State Rule	SR	Failure to contact the mayor(s) and municipal clerk(s) of each affected municipality by telephone and electronic mail within 1 hour of becoming aware of any situation requiring the issuance of a Tier 1 public notice per Chapter 279 supplementing P.L. 1977, c.224 (c,58:12A-1 et seq.).
1Y	Disinfection By-Product, Inorganic Compounds, Volatile Organic Compound, Radiological, Synthetic Organic Compounds, PFAS	State Violation Type	Failure to Remediate MCL within 1 Year	State Rule	State Rule	Failure to take any action necessary within one (1) year to bring the water into compliance with the applicable MCL, after incurring a violation of a promulgated MCL for any of the contaminants regulated pursuant to the National Regulations and N.J.A.C. 7:10-5.2, in accordance with N.J.A.C. 7:10-5.7(a).
02	Disinfection By-Product, Inorganic Compounds, Volatile Organic Compound, Radiological, Synthetic Organic Compounds	MCL	MCL, More Than 1 Sample	Any Regulated Contaminant		Failure to comply with the Maximum Contaminant Level (MCL) for any analyte set forth in 40 CFR 141 where the running annual average exceeds the MCL.
2A	Revised Total Coliform Rule	Treatment Technique	Level 1 Assess, Total Coliform Positive Routine No Repeat (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to conduct an assessment in accordance with 40 CFR 141.859(b) after exceeding any of the treatment technique triggers outlined in 40 CFR 141.859(a) in accordance with 40 CFR 141.860(b). <i>Specifically, your system failed to collect every required repeat sample for each total-coliform positive sample and failed to conduct an adequate Level 1 Assessment.</i>
2A	Revised Total Coliform Rule	Treatment Technique	Level 1 Assess, Multiple Total	Revised Total Coliform Rule	8000	Failure to conduct an assessment in accordance with 40 CFR 141.859(b) after exceeding any of the treatment technique triggers

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
			Coliform Positive (Revised Total Coliform Rule)			outlined in 40 CFR 141.859(a) in accordance with 40 CFR 141.860(b). <i>Specifically, your system had multiple total-coliform positive samples and failed to conduct an adequate Level 1 Assessment.</i>
2B	Revised Total Coliform Rule	Treatment Technique	Level 2 Assessment, 2nd Level 1 (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to conduct an assessment in accordance with 40 CFR 141.859(b) after exceeding any of the treatment technique triggers outlined in 40 CFR 141.859(a) in accordance with 40 CFR 141.860(b). <i>Specifically, your system had a second Level 1 Trigger, as defined in 40 CFR 141.859(a)(1), within a rolling 12-month period and failed to conduct an adequate Level 2 Assessment.</i>
2B	Revised Total Coliform Rule	Treatment Technique	Level 2 Assessment, MCL Triggered (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to conduct an assessment in accordance with 40 CFR 141.859(b) after exceeding any of the treatment technique triggers outlined in 40 CFR 141.859(a) in accordance with 40 CFR 141.860(b). <i>Specifically, your system had an E. coli MCL exceedance and failed to conduct an adequate Level 2 Assessment.</i>
2C	Revised Total Coliform Rule	Treatment Technique	Corrective/Expedited Actions (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to correct sanitary defects found through either Level 1 or Level 2 assessments within the specified timeframe in 40 CFR 141.859(b) and (c) and in accordance 40 CFR 141.860(b).
2D	Revised Total Coliform Rule	Treatment Technique	Startup Procedures Treatment Technique (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to complete state-approved start up procedures prior to serving water to the public in accordance with 40 CFR 141.856(a), 40 CFR 141.857(a) and 40 CFR 141.860(b)2).
03	Inorganic Compounds, Volatile Organic Compound, Radiological, Synthetic Organic Compounds	M&R	Monitoring	Any Regulated Contaminant		Failure to monitor for any analyte and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with N.J.A.C. 7:10 and 40 CFR 141.
3A	Revised Total Coliform Rule	Monitoring	Monitoring, Routine (Revised Total Coliform Rule)	E Coli	3014	Failure to monitor for total coliforms at a frequency specified in 40 CFR 141.853 et seq. in accordance with 40 CFR 141.860(c)(1).
3B	Revised Total Coliform Rule	Monitoring	Monitoring, Additional or Routine (Revised	E Coli	3014	Failure to conduct additional routine monitoring the month following one or more total-coliform positive samples in accordance with 40 CFR 141.854(j), 40 CFR 141.855(f) and 40 CFR 141.860(c)(1).

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
			Total Coliform Rule)			
3C	Revised Total Coliform Rule	Monitoring	Monitor Coliform Turbidity	E coli	3014	Failure to collect at least one total-coliform sample near the first service connection each day that the turbidity level of the source water exceeds 1 NTU, in accordance with 40 CFR 141.857(c).
3D	Revised Total Coliform Rule	Monitoring	Monitoring, Lab Cert/Method Error (Revised Total Coliform Rule)	E coli	3014	Failure to analyze for E. coli following a total coliform-positive routine sample in accordance with 40 CFR 141.860(c)2.
4A	Revised Total Coliform Rule	Reporting	Reporting, Assessment Forms, RTCR	E coli	3014	Failure to submit an assessment report within 30 days of triggering a Level 1 or Level 2 Assessment in accordance with 40 CFR 141.861(a)(3) and 40 CFR 141.860(d)(1).
4B	Revised Total Coliform Rule	Reporting	Report Sample Result/Failure to Monitor (Revised Total Coliform Rule)	E Coli	3014	Failure to submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with N.J.A.C. 7:10-5.4(a) and 40 CFR 141.860(d)(1).
4C	Revised Total Coliform Rule	Reporting	Report Startup Procedures - Certification Form (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to certify, prior to serving water to the public, that state-approved start up procedures have been complied with in accordance with 40 CFR 141.861(a)(5) and 40 CFR 141.860(d)(3).
5A	Revised Total Coliform Rule	Reporting	Sample Siting Plan Errors (Revised Total Coliform Rule)	Revised Total Coliform Rule	8000	Failure to develop an adequate written sample siting plan that identifies sampling sites and includes a sample collection schedule that is representative of the water throughout the distribution system in accordance with 40 CFR 141.853(a).
11	Disinfection By-Product	MRDL	MRDL, Non-Acute	Chlorine Dioxide, Chloramine, Chlorine	1008, 1006, 0999	Failure to comply with the Maximum Contaminant Level (MCL) for chlorine dioxide, chloramine, or chlorine as set forth in 40 CFR 141.65(a).
12	Disinfection By-Product	Treatment Technique	Qualified Operator Failure	Stage 1 Rule	0400	Failure to employ a state-approved qualified operator in accordance with 40 CFR 141.130(c).
13	Disinfection By-Product	MRDL	MRDL, Acute	Chlorine dioxide	1008	Failure to comply with the MRDL for chlorine dioxide in accordance with 40 CFR 141.133(c)(2)(i).

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
19	Ground Water Rule	M&R	Ground Water Rule Assessment Monitoring, Major	E Coli	3014	Failure to conduct assessment monitoring in accordance with 40 CFR 141.402(b).
20	Ground Water Rule	Reporting	Ground Water Rule Failure to Consult	Ground Water Rule	0700	Failure to consult with the state regarding the appropriate corrective action within 30 days of receiving written notification from a laboratory that a ground water source sample collected under 141.402(a)(3) was found to be fecal indicator-positive, or direction from the state that a fecal indicator-positive sample requires corrective action in accordance with 40 CFR 141.403(a)4.
27	Disinfection By-Product	M&R	Disinfection By-Product Monitoring	TTHM, HAA5	2950, 2456	Failure to monitor for disinfection byproducts (Total Trihalomethanes, Haloacetic Acids or both) and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, end of the monitoring period in accordance with N.J.A.C. 7:10-5.4(a) and 40 CFR 141.132(b)
27	Disinfection By-Product	M&R	Monitoring, Routine (Disinfection By-Product)	Disinfection By-Product Precursors	2920	Failure to monitor for disinfection by-product Precursors (source and finished water TOC samples and/or source water alkalinity samples) and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with N.J.A.C. 7:10-5.4(a) and 40 CFR 141.132(d).
27	Disinfection By-Product	M&R	Monitoring, Routine (Disinfection By-Product)	Bromate; also used for chlorite and chlorine dioxide	1011, 1009, 1008	Failure to monitor for bromate and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, end of the monitoring period in accordance with N.J.A.C. 7:10-5.4(a) and 40 CFR 141.132(b)3.
27	Disinfection By-Product	M&R	Monitoring, Routine (Disinfection By-Product)	Chlorine or Chloramine	0999, 1006	Failure to measure the disinfectant residual level in the distribution system at the same time and place as total coliforms are sampled as specified in 40 CFR 141.132(c)1 and/or submit a compliance sampling report to the Department within ten days after the end of each

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
						quarter in which samples were collected in accordance with 40 CFR 141.134(a).
29	Surface Water Treatment Rule	M&R	Failure to Produce Filter Assessment	Turbidity, Interim Enhanced Surface Water Treatment Rule	0100, 0300	Failure to conduct and submit a filter profile, filter self- assessment or comprehensive performance evaluation to the state in accordance with 40 CFR 141.175(b).
31	Ground Water Rule	Monitoring	Monitoring (Ground Water Rule)	Ground Water Rule	0700	Failure to monitor for the effectiveness and reliability of treatment of the ground water source and submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, in accordance with N.J.A.C. 7:10-5.4(a) and 40 CFR 141.403(b)3. (used for systems with 4 log treatment OR failure to collect 4hr gab samples upon failure of continuous monitoring equipment)
31	Surface Water Treatment Rule	M&R	Monitoring, (Surface Water Treatment Rule - Unfiltered Systems)	Chlorine, Chloramine	0999, 1006	Failure to measure the disinfectant residual level in the distribution system at the same time and place as total coliforms are sampled as specified in 40 CFR 141.74(b)6 and/or submit a compliance sampling report to the Department within ten days after the end of each month that the system serves water to the public in accordance with 40 CFR 141.75(b)(2), specifically more than 90% but less than 100% of the required samples were collected.
31	Surface Water Treatment Rule	M&R	Monitoring, Major (Surface Water Treatment Rule -Unfiltered Systems)	Chlorine, Chloramine	0999, 1006	Failure to continuously monitor the residual disinfectant concentration of the water entering the distribution system and/or report the lowest daily disinfectant residual along with the date and duration of any period when the residual disinfectant concentration fell below 0.2 mg/L in accordance with 40 CFR 141.74(c)2 and 40 CFR 141.75(b)2.
31	Surface Water Treatment Rule	M&R	Monitoring, Major (Surface Water Treatment Rule -Unfiltered Systems)	Turbidity	0100	Failure to perform turbidity measurements using a continuous turbidimeter on representative samples of filtered water and report values every four hours (or more frequently) that the system serves water to the public in accordance with 40 CFR 141.174(b).
32	Surface Water Treatment Rule		Monitoring, Source (Long-Term Enhanced Surface Water Treatment Rule)	E coli	3014	Failure to monitor as outlined in the approved Long-Term Enhanced Surface Water Treatment Rule Monitoring Schedule in accordance with 40 CFR 141. 701(b).

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
34	Ground Water Rule	Monitoring	Monitor Ground Water Rule Triggered/Additional	E. Coli	3014	Failure to collect a ground water source sample as specified in 40 CFR 141.402(a)1 and/or collect a groundwater sample within 24 hours of notification as specified in 40 CFR 141.402(a)2.
35	Disinfection By-Product Rule	Reporting	Failure Submit Operational Evaluation Level Report for HAA5 or TTHM	HAA5, TTHM	2456, 2950	Failure to conduct and/or submit an operational evaluation report to the state within 90 days of being notified of the analytical result that caused the operational evaluation level to be exceeded in accordance with 40 CFR 141.626(b)1.
36	Surface Water Treatment Rule	M&R	Monitoring, Major (Surface Water Treatment Rule -Filter)	Chloramine, Chlorine	1006, 0999	Failure to collect at least 90% of the required samples as specified in 40 CFR 141.74(c)(3) and/or submit a compliance sampling report to the Department within ten days after the end of each month that the system serves water to the public in accordance with 40 CFR 141.75(b)(2).
36	Surface Water Treatment Rule	M&R	Monitoring, Minor (Surface Water Treatment Rule -Filter)	Chloramine, Chlorine	1006, 0999	Failure to measure the disinfectant residual level in the distribution system at the same time and place as total coliforms are sampled as specified in 40 CFR 141.74(c)(3) and/or submit a compliance sampling report to the Department within ten days after the end of each month that the system serves water to the public in accordance with 40 CFR 141.75(b)(2), specifically more than 90% but less than 100% of the required samples were collected.
36	Surface Water Treatment Rule	M&R	Monitoring, Reporting (Surface Water Treatment Rule - Filter)	Turbidity	0100	Failure to perform turbidity measurements using a continuous turbidimeter on representative samples of filtered water and report values every four hours (or more frequently) that the system serves water to the public in accordance with 40 CFR 141.174.
37	Surface Water Treatment Rule	Treatment Technique	Treatment Technique, No Prior State Approval	Surface Water Treatment Rule	0800	Failure to profile or consult with the state before making a significant change to a disinfection practice if required to develop a disinfection profile in accordance with 40 CFR 141.530; 141.532; 141.536; 141.540; and 141.542.
38	Surface Water Treatment Rule	M&R	Monitoring, (Interim Enhanced Surface Water Treatment Rule) Routine	Turbidity	0100	Failure to conduct continuous monitoring of turbidity for each individual filter and/or failure to calibrate turbidimeters as specified by the manufacturer and/or failure to conduct grab sampling every four hours in lieu of continuous monitoring during a continuous monitoring equipment failure in accordance with 40 CFR 141.174.
41	Surface Water Treatment Rule	Treatment Technique	Res Disinfect Concentration	Chloramine, Chlorine	1006, 0999	Failure to maintain a detectable disinfectant residual concentration in the distribution system in at least 95% of samples collected each

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
			(Surface Water Treatment Rule)			month, for two consecutive months in accordance with 40 CFR 141.72(b).
41	Ground Water Rule	Treatment Technique	Failure to Maintain Microbial Treatment (Ground Water Rule)	Ground Water Rule	0700	Failure to provide and maintain at least 4-log treatment of viruses according to all compliance and permitting requirements and/or correct a failure of the 4-log treatment within four hours of determining that the treatment plant is not maintaining at least 4 log treatment before or at the first customer in accordance with 40 CFR 141.404(c).
42	Ground Water Rule	Treatment Technique	Failure to Provide Ground Water Rule Treatment	Ground Water Rule	0700	Failure to complete corrective actions within 120 days of receiving written notification from a laboratory that a ground water source sample collected under 141.402(a)(3) was found to be fecal indicator-positive, or direction from the state that a fecal indicator-positive sample requires corrective action in accordance with 40 CFR 141.403 et seq. and 40 CFR 141.404 et seq.
43	Surface Water Treatment Rule	Treatment Technique	Single Combined Filter Effluent (Interim Enhanced Surface Water Treatment Rule)	Turbidity	0100	Failure to comply with the filtration requirements as set forth in 40 CFR 141.173(a)(2).
44	Surface Water Treatment Rule	Treatment Technique	Monthly Combined Filter Effluent (Interim Enhanced Surface Water Treatment Rule)	Turbidity	0100	Failure to comply with the filtration requirements as set forth in 40 CFR 141.173(a)(1).
45	Ground Water Rule	Treatment Technique	Failure to Address Deficiency (Ground Water Rule)	Ground Water Rule	0700	Failure to correct a significant deficiency within 120 days as required under the Ground Water Rule, 40 CFR 141 Section S
46	Disinfection By-Product Rule	Treatment Technique	Inadequate Disinfection By-Product Precursor Removal	Total Organic Carbon	2920	Failure to meet the Treatment Technique requirements for Disinfection By-Product Precursor removal as set forth in 40 CFR 141.135(a). The running annual average greater than or equal to 1.0 percent removal was not maintained.
48	Ground Water Rule	Treatment Technique	Failure to Address Contamination	Ground Water Rule	0700	Failure to complete corrective actions within 120 days of receiving written notification from a laboratory that a ground water source sample collected under 141.402(a)(3) was found to be fecal indicator-

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
			(Ground Water Rule)			positive, or direction from the state that a fecal indicator-positive sample requires corrective action in accordance with 40 CFR 141.403 et seq. and 40 CFR 141.404 et seq.
51	Lead and Copper Rule	Monitoring	Initial Tap Sampling	Lead & Copper Rule	5000	Failure to monitor, or perform initial monitoring, for lead and/or copper and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with the N.J.A.C. 7:10-5.4(a) and 40 CFR 141.86.
52	Lead and Copper Rule	Monitoring	Follow-Up or Routine Tap M&R (Lead and Copper Rule)	Lead & Copper Rule	5000	'Failure to monitor for lead and/or copper and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with the N.J.A.C. 7:10-5.4(a) and 40 CFR 141.86.
53	Lead and Copper Rule	Monitoring	Initial/Follow-Up/Routine Water Quality Parameter M&R (Lead and Copper Rule)	Lead & Copper Rule	5000	Failure to monitor for water quality parameters and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with the N.J.A.C. 7:10-5.4(a) and 40 CFR 141.87.
56	Lead and Copper Rule	Monitoring	Initial/Follow-Up/Routine Source Water M&R (Lead and Copper Rule)	Lead & Copper Rule	5000	Failure to monitor and report source water lead and copper samples in accordance with 40 CFR 141.90(b) and 40 CFR 141.88.
57	Lead and Copper Rule	Treatment Technique	Submit Corrosion Control Plan	Lead & Copper Rule	5000	Failure to perform corrosion control studies and/or submit a recommendation regarding optimal corrosion control treatment after exceeding the lead or copper action level in accordance with 40 CFR 141.90(c)2.
58	Lead and Copper Rule	Treatment Technique	Install Corrosion Control Treatment	Lead & Copper Rule	5000	Failure to install corrosion control treatment in accordance with 40 CFR 141.82(e).
59	Lead and Copper Rule	Treatment Technique	Water Quality Parameter Level Non-Compliance	Lead & Copper Rule	5000	Failure to maintain optimal water quality parameters in accordance with 40 CFR 141.82(g).

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
			(Lead and Copper Rule)			
63	Lead and Copper Rule	Treatment Technique	MPL Level Non-Compliance	Lead & Copper Rule	5000	Failure to comply with the Maximum Permissible Level (MPL) for Lead and Copper in the source water in accordance with 40 CFR 141.83(b)5
64	Lead and Copper Rule	Treatment Technique	Lead Service Line Replacement (Lead and Copper Rule)	Lead & Copper Rule	5000	Failure to comply with the lead service line replacement requirements in accordance with 40 CFR 141.90(e).
65	Lead and Copper Rule	Treatment Technique	Submit Public Education (Lead and Copper Rule)	Lead & Copper Rule	5000	Failure to provide public education materials after exceeding the lead action level in accordance with 40 CFR 141.85(c).
66	Lead and Copper Rule	Reporting	Lead Consumer Notice (Lead and Copper Rule)	Lead & Copper Rule	5000	Failure to provide a Lead Consumer Notice as required by 40 CFR 141.85(d).
71	Consumer Confidence Report	Reporting	Consumer Confidence Report	Consumer Confidence Report Rule	7000	Failure to comply with the Consumer Confidence Report Rule as specified in 40 CFR 141.152 which requires water systems to prepare a Consumer Confidence Report annually, containing the previous year's data, and submit it to both their customers and the Department by July 1, as set forth in 40 CFR 141.155(c).
72	Consumer Confidence Report	Reporting	Consumer Confidence Report Certification	Consumer Confidence Report Rule	7000	Failure to comply with the Consumer Confidence Report Rule as specified in 40 CFR 141.152 and annually submit a Consumer Confidence Report Certification to the Department by October 1, as set forth in 40 CFR 141.155(c).
75	Public Notification	Reporting	Failure to Public Notice	Public Notice Rule	7500	Failure to give notice for a violation of National Primary Drinking Water Regulations as specified in 40 CFR 141.201 et seq. Failure to submit to the Department, within 10 days of completion, a certification and a representative copy of each type of notice distributed in accordance with 40 CFR 141.31(d).
C1	Lead and Copper Rule	ALE - State Violation Type	Action Level Exceedance	Copper	1022	Failure to comply with the Action Level (AL) for copper set forth in 40 CFR 141.80(c)(2).
CU	Lead and Copper Rule	ALE - State Violation Type	Action Level Exceedance	Copper	1022	Failure to comply with the Action Level (AL) for copper set forth in 40 CFR 141.80(c)(2). USED FOR NC/NP DAY CARE SYSTEMS
CV	State Surface Water Treatment Rule	State Reporting Violation	Calibration Violation	Disinfectant Residual, Turbidity	State Rule	Failure to verify the accuracy of performance of continuous analyzer(s) by collecting a grab sample of the effluent at least once in every 24-hour period as set forth in N.J.A.C. 7:10-9.6

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
D1	Lead and Copper Rule	State Violation Type	Failure to Submit Corrosion Control Treatment Recommendation for transient noncommunity/n on-public system	Lead & Copper Rule	5000	Failure to perform corrosion control studies and/or submit a recommendation regarding optimal corrosion control treatment after exceeding the lead or copper action level in accordance with NJAC 7:10-5 and N.J.A.C. 3A:52(5)(3)(i)(5)(iii).
D5	Lead and Copper Rule	State Violation Type	Initial Water Quality Parameter Non-Submittal for transient noncommunity/n on-public system	Lead & Copper Rule	5000	Failure to monitor for water quality parameters and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with NJAC 7:10-5 and N.J.A.C. 3A:52(5)(3)(i)(5)(iii).
D7	Lead and Copper Rule	State Violation Type	Water Quality Parameter Optimal Monitoring for transient noncommunity/n on-public system	Lead & Copper Rule	5000	Failure to monitor for water quality parameters and/or submit a compliance sampling report to the Department within the first ten days of the month following the month in which any test, measurement, or analysis is made, or the first ten days following the end of the required monitoring period, whichever of these is shortest, in accordance with NJAC 7:10-5 and N.J.A.C. 3A:52(5)(3)(i)(5)(iii).
LA	Lead and Copper Rule	State Violation Type	Lead Service Line Rule Violation	Lead	State Rule	Failure to provide a lead service line replacement progress report detailing the system's replacement progress to the state in accordance with P.L. 2021, Chapter 183.
LS	Lead and Copper Rule	State Violation Type	Lead Service Line Rule Violation	Lead	State Rule	Failure to provide an inventory of all lead-containing materials within their drinking water system to the state in accordance with P.L. 2021, Chapter 183.
LP	Lead and Copper Rule	State Violation Type	Lead Service Line Rule Violation	Lead	State Rule	Failure to provide a lead service line replacement plan detailing how the water system intends to replace all lead service lines within their drinking water system to the state in accordance with P.L. 2021, Chapter 183.
P1	Lead and Copper Rule	ALE- State Violation Type	Action Level Exceedance	Lead	1030	Failure to comply with the Action Level (AL) for lead set forth in 40 CFR 141.80(c)(1). USED FOR NC/NP DAY CARE SYSTEMS
PB	Lead and Copper Rule	ALE- State Violation Type	Action Level Exceedance	Lead	1030	Failure to comply with the Action Level (AL) for lead set forth in 40 CFR 141.80(c)(1).

SDWIS Viol. Code	Applicable Rule(s)	Violation Type	Violation Description	Analyte Name(s)	SDWIS Analyte or Rule Code(s)	Description of Noncompliance
MC	Inorganic Compounds, Volatile Organic Compound Rule, Synthetic Organic Compounds Rule, PFAS	MCL- State Type Violation	NJ MCL	Any State Regulated Contaminant	State Rule	Failure to comply with the Maximum Contaminant Level (MCL) for any analyte set forth in N.J.A.C. 7:10-5.2.
NJ	Volatile Organic Compound Rule, Synthetic Organic Compounds Rule, PFAS	M&R- State Type Violation	NJ Non-Submittal	Any State Regulated Contaminant	State Rule	Failure to monitor in accordance with N.J.A.C. 7:10-5.2
RM	Inorganic Compounds, Volatile Organic Compound Rule, RAD, Synthetic Organic Compounds Rule, PFAS	State Reporting Violation	NJ Non-Submittal	Any Regulated Contaminant	State Rule	Failure to submit a Remedial Measures Report in accordance with N.J.A.C. 7:10-5.1 and N.J.A.C. 7:10A-1.12(b)1.
TD	Inorganic Compounds, Volatile Organic Compound Rule, RAD, Synthetic Organic Compounds Rule, PFAS	State Violation Type	Failure to Maintain Treatment	Any Regulated Contaminant	State Rule	Failure to maintain a treatment device in accordance with N.J.A.C. 7:10-5.7(e).

Appendix B: Safe Drinking Water Act Violations Incurred by Rule and Category

Number of violations per analyte, per rule and number of systems incurring these violations for calendar year 2023.

Note 1 – grayed out boxes indicate that the rule does not include that category of violation

Note 2 – a zero indicates that no violations were incurred by any water system in 2023

Revised Total Coliform Rule

VIOL. CODE	VIOLATION DESCRIPTION	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
1A	MCL, E. COLI, POS E COLI (REVISED TOTAL COLIFORM RULE)	16	15								
2A	LEVEL 1 ASSESS, MULTIPLE TC POS (REVISED TOTAL COLIFORM RULE)					56	55				
	LEVEL 1 ASSESS, TC POS RT NO RPT (REVISED TOTAL COLIFORM RULE)					2	2				
2B	LEVEL 2 ASSESSMENT, 2ND LEVEL 1 (REVISED TOTAL COLIFORM RULE)					43	31				
	LEVEL 2 ASSESSMENT, MCL TRIGGERED (REVISED TOTAL COLIFORM RULE)					5	5				
2C	CORRECTIVE/EXPEDITED ACTIONS (REVISED TOTAL COLIFORM RULE)					4	4				
3A	MONITORING, ROUTINE, MAJOR (REVISED TOTAL COLIFORM RULE)							555	320		
	MONITORING, ROUTINE, MINOR (REVISED TOTAL COLIFORM RULE)							31	15		
3B	MONITORING, ADD. ROUTINE, MAJOR (REVISED TOTAL COLIFORM RULE)							22	22		
	MONITORING, ADD. ROUTINE, MINOR (REVISED TOTAL COLIFORM RULE)							5	4		
4A	REPORTING, ASSESSMENT FORMS (RTCR)									12	12
4B	REPORT SAMPLE RESULT/FAIL MONITOR REVISED TOTAL COLIFORM RULE									738	395

5A	SAMPLE SITING PLAN ERRORS (REVISED TOTAL COLIFORM RULE)									3	3
SEASONAL SYSTEM SPECIFIC VIOLATIONS											
2D	STARTUP PROCEDURES TREATMENT TECHNIQUE (REVISED TOTAL COLIFORM RULE)					77	72				
4C	REPORT STARTUP PROCEDURES CERT FORM REVISED TOTAL COLIFORM RULE									0	0

Ground Water Rule

VIOL. CODE	VIOLATION DESCRIPTION	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
19	MONITOR, GWR ASSESSMENT, MAJOR							2	1		
20	FAILURE TO CONSULT, GROUND WATER RULE									1	1
31	MONITORING, RTN/RPT MAJOR (GROUND WATER RULE)							35	16		
	MONITORING, RTN/RPT MINOR (GROUND WATER RULE)							0	0		
34	MONITOR GROUND WATER RULE TRIGGERED/ADDITONAL, MAJOR							50	41		
	MONITOR GROUND WATER RULE TRIGGERED/ADDITONAL, MINOR							25	22		
41	FAILURE MAINTAIN MICROBIAL TREATMENT (GROUND WATER RULE)					0	0				
45	FAILURE ADDRESS DEFICIENCY (GWR)					0	0				
48	FAILURE TO ADDRESS CONTAMINATION (GROUND WATER RULE)					11	11				

Disinfectant and Disinfection By-Product Rule: Total Trihalomethanes, Total Haloacetic Acids and Disinfectant By-Product Precursors

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
0999	CHLORINE			0	0	0	0	109	51		
2456	TOTAL HALOACETIC ACIDS (HAA5)	0	0					42	40	1	1
2950	TTHM	3	2					35	33	1	1

Surface Water Treatment Rules

ANALYTE CODE	ANALYTE/RULE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
0999	CHLORINE					4	3	4	2		
0300	INTERIM ENHANCED SURFACE WATER TREATMENT RULE					2	1	1	1		
0100	TURBIDITY					0	0	2	2		

Inorganic Compounds

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
1074	ANTIMONY, TOTAL	0	0			0	0	1	0
1005	ARSENIC	3	1			1	1	9	7

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
1094	ASBESTOS	0	0			0	0	0	0
1010	BARIUM	0	0			0	0	1	1
1075	BERYLLIUM, TOTAL	0	0			0	0	1	1
1015	CADMIUM	0	0			0	0	1	1
1020	CHROMIUM	0	0			0	0	1	1
1024	CYANIDE	0	0			0	0	0	0
1025	FLUORIDE	0	0			0	0	0	0
1035	MERCURY	0	0			0	0	0	0
1036	NICKEL	0	0			0	0	1	1
1040	NITRATE	10	8			5	5	163	146
1041	NITRITE	0	0			0	0	10	10
1045	SELENIUM	0	0			0	0	1	1
1085	THALLIUM, TOTAL	0	0			0	0	1	1

Volatile Organic Compounds

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
2981	1,1,1-TRICHLOROETHANE	0	0			0	0	36	31
2988	1,1,2,2-TETRACHLOROETHANE*	0	0			0	0	0	0
2985	1,1,2-TRICHLOROETHANE	0	0			0	0	35	30
2978	1,1-DICHLOROETHANE*	0	0			0	0	0	0
2977	1,1-DICHLOROETHYLENE	0	0			0	0	35	30
2378	1,2,4-TRICHLOROBENZENE	0	0			0	0	35	30
2980	1,2-DICHLOROETHANE	0	0			0	0	35	30
2983	1,2-DICHLOROPROPANE	0	0			0	0	35	30

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
2990	BENZENE	3	1			0	0	35	30
2982	CARBON TETRACHLORIDE	0	0			0	0	35	30
2989	CHLOROBENZENE	0	0			0	0	35	30
2380	CIS-1,2-DICHLOROETHYLENE	0	0			0	0	35	30
2964	DICHLOROMETHANE	0	0			0	0	35	30
2992	ETHYLBENZENE	0	0			0	0	35	30
2967	M-DICHLOROBENZENE*	0	0			0	0	0	0
2251	METHYL TERT-BUTYL ETHER*	0	0			0	0	0	0
2248	NAPHTHALENE*	0	0			0	0	0	0
2968	O-DICHLOROBENZENE	0	0			0	0	35	30
2969	P-DICHLOROBENZENE	0	0			0	0	35	30
2996	STYRENE	0	0			0	0	35	30
2987	TETRACHLOROETHYLENE	4	2			0	0	35	30
2991	TOLUENE	0	0			0	0	35	30
2979	TRANS-1,2-DICHLOROETHYLENE	0	0			0	0	35	30
2984	TRICHLOROETHYLENE	0	0			0	0	35	30
2976	VINYL CHLORIDE	0	0			0	0	35	30
2955	XYLENES, TOTAL	0	0			0	0	35	30

*These analytes are only sampled as per state regulations

Radiologicals

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
4010	COMBINED RADIUM (-226 & -228)	12	6			2	2	53	38
4006	COMBINED URANIUM	3	2			2	2	47	29
4000	GROSS ALPHA, EXCL. RADON & U	21	9			2	2	54	38
4020	RADIUM-226					2	2	47	32
4030	RADIUM-228					2	2	51	36

Synthetic Organic Compounds

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
2414	1,2,3-TRICHLOROPROPANE	0	0			0	0	41	26
2931	1,2-DIBROMO-3-CHLOROPROPANE	0	0			0	0	43	27
2063	2,3,7,8-TCDD	0	0			0	0	0	0
2110	2,4,5-TP	0	0			0	0	0	0
2105	2,4-D	0	0			0	0	3	2
2047	ALDICARB	0	0			0	0	0	0
2044	ALDICARB SULFONE	0	0			0	0	0	0
2043	ALDICARB SULFOXIDE	0	0			0	0	0	0
2050	ATRAZINE	0	0			0	0	0	0
2306	BENZO(A)PYRENE	0	0			0	0	0	0
2010	BHC-GAMMA	0	0			0	0	0	0
2046	CARBOFURAN	0	0			0	0	0	0
2959	CHLORDANE	0	0			0	0	0	0
2031	DALAPON	0	0			0	0	0	0
2035	DI(2-ETHYLHEXYL) ADIPATE	0	0			0	0	0	0
2039	DI(2-ETHYLHEXYL) PHTHALATE	0	0			0	0	0	0

ANALYTE CODE	ANALYTE	MAXIMUM CONTAMINANT LEVEL VIOLATIONS		MAXIMUM RESIDUAL DISINFECTANT LEVEL VIOLATIONS		TREATMENT TECHNIQUE VIOLATIONS		MONITORING & REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
2041	DINOSEB	0	0			0	0	1	1
2032	DIQUAT	0	0			0	0	0	0
2033	ENDOTHALL	0	0			0	0	0	0
2005	ENDRIN	0	0			0	0	0	0
2946	ETHYLENE DIBROMIDE	0	0			0	0	43	27
2034	GLYPHOSATE	0	0			0	0	0	0
2065	HEPTACHLOR	0	0			0	0	0	0
2067	HEPTACHLOR EPOXIDE	0	0			0	0	0	0
2274	HEXACHLOROBENZENE	0	0			0	0	0	0
2042	HEXACHLOROCYCLOPENTADIENE	0	0			0	0	0	0
2051	LASSO	0	0			0	0	0	0
2015	METHOXYCHLOR	0	0			0	0	0	0
2036	OXAMYL	0	0			0	0	0	0
2326	PENTACHLOROPHENOL	0	0			0	0	0	0
2040	PICLORAM	0	0			0	0	0	0
2037	SIMAZINE	0	0			0	0	0	0
2383	TOTAL POLYCHLORINATED BIPHENYLS (PCB)	0	0			0	0	0	0
2020	TOXAPHENE	0	0			0	0	0	0

Per- and polyfluoroalkyl substances

Analyte Code	Analyte	Maximum Contaminant Level Violations		Maximum Residual Disinfectant Level Violations		Treatment Technique Violations		Monitoring & Reporting Violations	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
2804	PERFLUORONONANOIC ACID	5	3			-	-	88	60
2805	PERFLUOROCTANE SULFONIC ACID (PFOS)	80	23			-	-	88	60
2806	PERFLUOROCTANOIC ACID (PFOA)	197	30			-	-	88	60

Lead and Copper Rule

VIOL. CODE	VIOLATION DESCRIPTION	ACTION LEVEL EXCEEDANCES		TREATMENT TECHNIQUE VIOLATIONS		MONITORING VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
51	INITIAL TAP SAMPLING (LEAD AND COPPER RULE)					0	0		
52	FOLLOW-UP OR ROUTINE TAP M&R (LEAD AND COPPER RULE)					32	31		
53	WATER QUALITY PARAMETER M&R (LEAD AND COPPER RULE)					234	158		
56	INITIAL/FOLLOW-UP/ROUTINE SOWT M&R (LEAD AND COPPER RULE)					9	8		
57	OCCT/SOWT RECOMMENDATION/STUDY (LEAD AND COPPER RULE)			9	8				
58	OCCT/SOWT INSTALL DEMONSTRATION (LEAD AND COPPER RULE)			11	11				
59	WATER QUALITY PARAMETER LEVEL NON-COMPLIANCE (LEAD AND COPPER RULE)			62	49				
64	LEAD SERVICE LINE REPLACEMENT (LEAD AND COPPER RULE)			1	1				
65	PUBLIC EDUCATION (LEAD AND COPPER RULE)			1	1				
66	LEAD CONSUMER NOTICE (LEAD AND COPPER RULE)							244	205
C1	COPPER ACTION LEVEL EXCEEDANCE NC/NP	1	1						
CU	COPPER ACTION EXCEEDED	16	16						
D1	SUBMIT CCT FOR NC/NP SYS (FED TYPE 57)			0	0				
D5	INITIAL WATER QUALITY PARAMETER NONSUBMITTAL FOR NC/NP (53)					0	0		
D7	WATER QUALITY PARAMETER OPTIMAL MONITORING FOR NC/NP (WO)					0	0		
L1	LEAD ACTION LEVEL EXCEEDED, NC/NP	0	0						
PB	LEAD ACTION LEVEL EXCEEDED	23	23						

VIOL. CODE	VIOLATION DESCRIPTION	ACTION LEVEL EXCEEDANCES		TREATMENT TECHNIQUE VIOLATIONS		MONITORING VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems	# Viol.	# Systems
P1	PUBLIC EDUCATION (LCR) FOR NC/NP SYSTEMS							0	0

Public & Consumer Notification and Reporting

VIOL. CODE	VIOLATION DESCRIPTION	PUBLIC NOTIFICATION VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems
71	CONSUMER CONFIDENCE REPORT			61	53
72	CCR ADEQUACY/AVAILABILITY/CONTENT			20	15
75	PUBLIC NOTICE RULE LINKED TO VIOLATION	62	49		
76	PUBLIC NOTICE RULE NOT LINKED TO VIOLATION	44	32		

Additional State SDWA Rules

VIOL. CODE	VIOLATION DESCRIPTION	TREATMENT TECHNIQUE VIOLATIONS		REPORTING VIOLATIONS	
		# Viol.	# Systems	# Viol.	# Systems
1Y	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR	36	26		
RM	NONSUBMITTAL OF REMEDIAL MEASURE RRT			7	5
CV	CALIBRATION VIOLATION			0	0
LS	STATE LEAD SERVICE LINE RULE VIOLATION			96	81
LA	STATE LEAD SERVICE LINE RULE VIOLATION			132	131
LP	STATE LEAD SERVICE LINE RULE VIOLATION			150	146
1H	NOTIFICATION OF TIER 1 WITHIN 1 HOUR			1	1

Appendix C: Community Water System 2023 Action Level Exceedance, Maximum Contaminant Level Exceedance, and Treatment Technique Violations

The absence of a Return to Compliance date indicates systems/violations that have not returned to compliance as of May 8, 2024. Note: Apparent duplicate entries in the table are due to requirements to sample at each Point of Entry (POE) to the distribution system. Community Water systems may have multiple POEs and though a single violation will cause a Community Water System to be considered out of compliance, each POE is viewed separately when determining the Return to Compliance Date.

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
<i>Action Level Exceedances</i>						
NJ0436001	ANCORA PSYCHIATRIC HOSPI	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ0502001	CAPE MAY WATER & SEWER U	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ0504306	OCEANVIEW CTR FOR REHAB AND CONTINUING C	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ1427006	MOUNT OLIVE TWP W D SAND	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ1518010	MANCHESTER VILLAGE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1704001	LEISURE ARMS COMPLEX	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	12/31/2023	
NJ1904006	STRAWBERRY POINT POA	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2021	12/31/2023	
NJ1904007	COLBY WATER CO	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2021	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1918003	SPARTA TWP WATER UTILITY -- HIGHLANDS	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ2116002	HILLSIDE VILLAGE	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
Maximum Contaminant Level Exceedances						
NJ0221001	GARFIELD WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	7/12/2023
NJ0221001	GARFIELD WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	7/12/2023
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0228001	HO HO KUS WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0242001	OAKLAND WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0251001	RIDGEWOOD WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0264001	WALDWICK WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0306001	BURLINGTON TWP W DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0407001	BROOKLAWN WATER DEPARTME	PERFLUORONONANOIC ACID (PFNA) (2804)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0407001	BROOKLAWN WATER DEPARTME	PERFLUORONONANOIC ACID (PFNA) (2804)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0407001	BROOKLAWN WATER DEPARTME	PERFLUORONONANOIC ACID (PFNA) (2804)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	1/1/2023	3/31/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0607001	HOPEWELL PLACE SENIOR APTS	COMBINED RADIUM (-226 & -228) (4010)	MCL, AVERAGE (02)	4/1/2023	6/30/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	7/1/2023	9/30/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	10/1/2023	12/31/2023	
NJ0614002	BERRYMAN'S BRANCH MHP	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	1/1/2023	3/31/2023	7/31/2023
NJ0614002	BERRYMAN'S BRANCH MHP	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	7/1/2023	9/30/2023	7/31/2023
NJ0614005	UNITED MOBILE HOMES OF VINELAND	COMBINED RADIUM (-226 & -228) (4010)	MCL, AVERAGE (02)	1/1/2023	3/31/2023	10/24/2023
NJ0614005	UNITED MOBILE HOMES OF VINELAND	COMBINED RADIUM (-226 & -228) (4010)	MCL, AVERAGE (02)	4/1/2023	6/30/2023	10/24/2023
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0720001	VERONA WATER DEPARTMENT	TTHM (2950)	MCL, LRAA (02)	7/1/2023	9/30/2023	
NJ0720001	VERONA WATER DEPARTMENT	TTHM (2950)	MCL, LRAA (02)	10/1/2023	12/31/2023	
NJ0812001	NATIONAL PARK WATER DEPARTMENT	PERFLUORONONANOIC ACID (PFNA) (2804)	NJ MCL (MC)	1/1/2023	3/31/2023	7/13/2023
NJ0821001	WESTVILLE WATER DEPARTMENT	PERFLUORONONANOIC ACID (PFNA) (2804)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1106002	MERCER COUNTY CORRECTIONAL CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1106002	MERCER COUNTY CORRECTIONAL CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1106002	MERCER COUNTY CORRECTIONAL CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1106002	MERCER COUNTY CORRECTIONAL CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1225001	MIDDLESEX WATER COMPANY	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	2/22/2023	7/31/2023	8/1/2023
NJ1415002	KINNELON WATER DEPT	TTHM (2950)	MCL, LRAA (02)	10/1/2023	12/31/2023	
NJ1425001	MOUNTAIN LAKES WATER DEP	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1425001	MOUNTAIN LAKES WATER DEP	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1427008	MT OLIVE TWP WD PINECREST	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1427008	MT OLIVE TWP WD PINECREST	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1427008	MT OLIVE TWP WD PINECREST	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1427008	MT OLIVE TWP WD PINECREST	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1508001	OAKS MHP LLC	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1508001	OAKS MHP LLC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1604001	HAWTHORNE WATER DEPARTMENT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1606301	HOLLAND CHRISTIAN HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1606301	HOLLAND CHRISTIAN HOME	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1606301	HOLLAND CHRISTIAN HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1606301	HOLLAND CHRISTIAN HOME	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1615008	PVWC-POSTBROOK	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1615017	WONDER LAKE PROPERTIES I	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1615017	WONDER LAKE PROPERTIES I	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1615017	WONDER LAKE PROPERTIES I	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1615017	WONDER LAKE PROPERTIES I	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1708001	PENNSVILLE TWSP. WATER DEPART.	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1710003	PICNIC GROVE MOBILE HOMES	BENZENE (2990)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1710003	PICNIC GROVE MOBILE HOMES	BENZENE (2990)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1710003	PICNIC GROVE MOBILE HOMES	BENZENE (2990)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1710304	BIG OAK REHAB	NITRATE (1040)	MCL, AVERAGE (02)	7/1/2023	9/30/2023	
NJ1815300	THE MATHENY SCHOOL & HOSPITAL INC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	4/27/2023
NJ1815300	THE MATHENY SCHOOL & HOSPITAL INC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	4/27/2023
NJ1817001	ROCKY HILL W DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	4/1/2024
NJ1817001	ROCKY HILL W DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	4/1/2024
NJ1817001	ROCKY HILL W DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	4/1/2024
NJ1817001	ROCKY HILL W DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	4/1/2024

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1904006	STRAWBERRY POINT POA	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1904006	STRAWBERRY POINT POA	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1904006	STRAWBERRY POINT POA	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1904006	STRAWBERRY POINT POA	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1905004	SUSSEX CNTY HLTH-THE HOMESTED	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1905004	SUSSEX CNTY HLTH-THE HOMESTED	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1905004	SUSSEX CNTY HLTH-THE HOMESTED	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1905004	SUSSEX CNTY HLTH-THE HOMESTED	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1905004	SUSSEX CNTY HLTH-THE HOMESTED	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1911002	LAKE STOCKHOLM INC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1911002	LAKE STOCKHOLM INC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	10/18/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	10/18/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	5/17/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	10/18/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	10/18/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	10/18/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	10/18/2023
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1912001	HOPATCONG WATER DEPT	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ2123002	WINDTRYST APTS	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	8/1/2023	8/31/2023	9/5/2023
<i>Treatment Technique Violations</i>						
NJ0103001	BRIGANTINE WATER DEPARTMENT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0113001	HAMMONTON WATER DEPT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/22/2022	2/8/2023	2/8/2023
NJ0123002	THE OAKS OF WEYMOUTH WATER CO.	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	1/1/2024

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0221001	GARFIELD WATER DEPARTMENT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	6/2/2022	7/12/2023	7/12/2023
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	2/23/2023		
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	9/15/2023	10/3/2023	10/3/2023
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/29/2023		
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/29/2023		
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/29/2023		
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/29/2023		
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/29/2023		
NJ0251001	RIDGEWOOD WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/29/2023		
NJ0264001	WALDWICK WATER DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	3/18/2023		
NJ0303001	BORDENTOWN WATER DEPARTM	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	4/25/2024
NJ0306001	BURLINGTON TWP W DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	4/2/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0315001	FLORENCE TWP W DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	9/21/2023		
NJ0319001	MAPLE SHADE WATER DEPARTMENT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	3/15/2023
NJ0436001	ANCORA PSYCHIATRIC HOSPI	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ0436001	ANCORA PSYCHIATRIC HOSPI	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0605001	FAIRTON OAKS M H COMMUNITY	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	12/31/2023
NJ0607001	HOPEWELL PLACE SENIOR APTS	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	7/1/2023	9/30/2023	
NJ0607001	HOPEWELL PLACE SENIOR APTS	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0610001	MILLVILLE WATER DEPARTMENT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	12/31/2023
NJ0613004	UPPER DEERFIELD TWP WATER DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	7/11/2019	7/5/2023	7/5/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0614003	VINELAND WATER & SEWER UTILITY	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0614005	UNITED MOBILE HOMES OF VINELAND	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/16/2022	4/20/2023	4/20/2023
NJ0614005	UNITED MOBILE HOMES OF VINELAND	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/16/2022	4/20/2023	10/24/2023
NJ0701001	BELLEVILLE WATER DEPT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	1/19/2024
NJ0702001	BLOOMFIELD WATER DEPARTMENT	LEAD & COPPER RULE (5000)	LEAD SERVICE LINE REPLACEMENT (LCR) (64)	7/1/2020	3/31/2023	3/31/2023
NJ0704001	CEDAR GROVE WATER DEPT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ0710001	LIVINGSTON TWP DIV OF WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	1/14/2023		
NJ0710001	LIVINGSTON TWP DIV OF WATER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	5/18/2023		
NJ0716001	NUTLEY WATER DEPT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ0716001	NUTLEY WATER DEPT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/19/2023		
NJ0812001	NATIONAL PARK WATER DEPARTMENT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	1/17/2021	2/21/2023	2/21/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0814001	PAULSBORO WATER DEPARTMENT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0907001	KEARNY WATER DEPARTMENT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1019311	LITTLE BROOK NURSING CONVALESCENT HOME	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1023001	STOCKTON WATER DEPARTMENT	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	1/1/2023		
NJ1105001	HOPEWELL BORO W DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	7/8/2023		
NJ1106002	MERCER COUNTY CORRECTIONAL CENTER	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	2/16/2023		
NJ1223001	SOUTH RIVER W DEPT	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	1/1/2023	5/23/2023	5/23/2023
NJ1223001	SOUTH RIVER W DEPT	CHLORINE (0999)	RES DISINFECT CONCENTRATION (SWTR) (41)	8/1/2023	8/31/2023	
NJ1306001	BELMAR WATER DEPT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	12/28/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1410001	EAST HANOVER TWP WATER DEPT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1414003	JEFFERSON TWP W U MILTON SYS	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	5/5/2023		
NJ1414003	JEFFERSON TWP W U MILTON SYS	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1414011	JEFFERSON TWP W U LK HOP	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1414011	JEFFERSON TWP W U LK HOP	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1421003	MONTVILLE TWP MUA	CHLORINE (0999)	RES DISINFECT CONCENTRATION (SWTR) (41)	7/1/2023	7/31/2023	1/26/2024
NJ1427001	MT OLIVE VILLAGES WATER	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1427001	MT OLIVE VILLAGES WATER	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1427008	MT OLIVE TWP WD PINECREST	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	1/1/2023		
NJ1427008	MT OLIVE TWP WD PINECREST	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	7/30/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1435002	ROCKAWAY TWP WATER DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	2/17/2023		
NJ1436004	ROXBURY TWP W DEPT-SKY V	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	12/31/2024
NJ1512001	LACEY TWP MUA	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1518010	MANCHESTER VILLAGE	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1518010	MANCHESTER VILLAGE	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1613002	WANAQUE W DEPT.	CHLORINE (0999)	RES DISINFECT CONCENTRATION (SWTR) (41)	10/1/2023	10/31/2023	
NJ1613002	WANAQUE W DEPT.	CHLORINE (0999)	RES DISINFECT CONCENTRATION (SWTR) (41)	12/1/2023	12/31/2023	
NJ1615009	REFLECTION LAKES GARDEN APARTMENTS	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1615340	COMPLETE CARE AT MILFORD MANOR LLC	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	11/17/2023		
NJ1710304	BIG OAK REHAB	NITRATE (1040)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	7/1/2023	9/30/2023	
NJ1815300	THE MATHENY SCHOOL & HOSPITAL INC	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	4/14/2022	2/23/2023	2/23/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1902003	LAKE LENAPE WATER CO	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/15/2022	7/9/2023	7/9/2023
NJ1902008	LIMECREST SUBACUTE AND REHAB CENTER	LEAD & COPPER RULE (5000)	PUBLIC EDUCATION (LCR) (65)	8/30/2022	3/31/2023	3/31/2023
NJ1902008	LIMECREST SUBACUTE AND REHAB CENTER	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	1/1/2023		
NJ1904004	NORTH SHORE WATER ASSOCIATION	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	1/19/2023		
NJ1911002	LAKE STOCKHOLM INC	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	1/19/2023		
NJ1911003	LAKE TAMARACK W CO	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1912001	HOPATCONG WATER DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	7/9/2022	3/16/2023	3/16/2023
NJ1912001	HOPATCONG WATER DEPT	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/9/2023		
NJ1918004	SPARTA TWP WATER UTILITY - LAKE MOHAWK	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	7/14/2023		
NJ1921001	SUSSEX W DEPT	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1922011	VEOLIA WATER NEW JERSEY SUNSET RIDGE	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1922011	VEOLIA WATER NEW JERSEY SUNSET RIDGE	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1922026	VEOLIA WATER NEW JERSEY VERNON VALLEY	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	

Appendix D: Non-Community, and Non-public Water System 2023 Action Level Exceedance, Maximum Contaminant Level Exceedance, and Treatment Technique violations

Note - the absence of a Return to Compliance date indicates systems/violations that have not returned to compliance as of May 8, 2024.

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
Action Level Exceedances						
NJ0105315	COLLINGS LAKE ELEMENTARY SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	12/31/2023	
NJ0105315	COLLINGS LAKE ELEMENTARY SCHOOL	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	12/31/2023	
NJ0110307	SOUTH JERSEY GAS CO	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ0111441	SMITHVILLE PROFESSIONAL CENTER	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2021	12/31/2023	
NJ0111460	HOLLY ACRES CAMPGROUND	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ0263320	SADDLE RIVER REFORMED CHURCH	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	12/31/2023	
NJ0613307	SEABROOK HOUSE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	12/31/2023	
NJ0805453	FIRST PRESBYTERIAN CHURCH	COPPER, FREE (1022)	COPPER ACTION LEVEL EXCEEDANCE NC/NP (C1)	1/1/2021	12/31/2023	
NJ0824317	US DROP FORGE CO	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2021	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1019315	LEBANON TWP SCH - VALLEY VW WOODGLEN	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1022342	READINGTON MUNICIPAL BLD	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1025326	MOUNTAIN VIEW 78	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ1101303	PRINCETON WINDSOR OFFICE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1113301	SRI INTERNATIONAL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1407314	KESSELER INSTITUTE FOR REHAB	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1427373	VEOLIA ENVIRONMENTAL SERVICES	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1435346	KATHERINE D MALLONE SCH	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1435346	KATHERINE D MALLONE SCH	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1511431	THE PREPARATORY ACADEMY	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1514362	CONGREGATION VORKA EDUCATION CENTER	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1615324	MAPLE ROAD ELEMENTARY SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1615325	MACOPIN MIDDLE SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1615329	MARSHALL HILL ELEM SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2021	12/31/2023	
NJ1615459	ALFA DEVELOPMENT INC- UNION VALLEY ROAD	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1706300	JOHN FENWICK REST STOP	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ1714300	REAL HOUSE	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1714300	REAL HOUSE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1803304	SOMERSET HILLS COUNTRY CLUB	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1810350	HILLSBOROUGH MEDICAL BUILDING	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	12/8/2023
NJ1902361	MANOR PLAZA CONDO ASSOCIATION COMPLEX	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ0105315	COLLINGS LAKE ELEMENTARY SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	12/31/2023	
NJ0105315	COLLINGS LAKE ELEMENTARY SCHOOL	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	12/31/2023	
NJ0110307	SOUTH JERSEY GAS CO	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ0111441	SMITHVILLE PROFESSIONAL CENTER	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2021	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0111460	HOLLY ACRES CAMPGROUND	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ0263320	SADDLE RIVER REFORMED CHURCH	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	12/31/2023	
NJ0613307	SEABROOK HOUSE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	12/31/2023	
NJ0805453	FIRST PRESBYTERIAN CHURCH	COPPER, FREE (1022)	COPPER ACTION LEVEL EXCEEDANCE NC/NP (C1)	1/1/2021	12/31/2023	
NJ0824317	US DROP FORGE CO	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2021	12/31/2023	
NJ1019315	LEBANON TWP SCH - VALLEY VW WOODGLEN	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1022342	READINGTON MUNICIPAL BLD	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1025326	MOUNTAIN VIEW 78	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ1101303	PRINCETON WINDSOR OFFICE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1113301	SRI INTERNATIONAL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1407314	KESSELER INSTITUTE FOR REHAB	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1427373	VEOLIA ENVIRONMENTAL SERVICES	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1435346	KATHERINE D MALLONE SCH	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1435346	KATHERINE D MALLONE SCH	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1511431	THE PREPARATORY ACADEMY	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1514362	CONGREGATION VORKA EDUCATION CENTER	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1615324	MAPLE ROAD ELEMENTARY SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1615325	MACOPIN MIDDLE SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1615329	MARSHALL HILL ELEM SCHOOL	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2021	12/31/2023	
NJ1615459	ALFA DEVELOPMENT INC- UNION VALLEY ROAD	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	
NJ1706300	JOHN FENWICK REST STOP	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	1/1/2023	6/30/2023	
NJ1714300	REAL HOUSE	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1714300	REAL HOUSE	COPPER, FREE (1022)	COPPER ACTION EXCEEDED (CU)	7/1/2023	12/31/2023	
NJ1803304	SOMERSET HILLS COUNTRY CLUB	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
NJ1810350	HILLSBOROUGH MEDICAL BUILDING	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	1/1/2023	6/30/2023	12/8/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1902361	MANOR PLAZA CONDO ASSOCIATION COMPLEX	LEAD (1030)	LEAD ACTION LEVEL EXCEEDED (PB)	7/1/2023	12/31/2023	
Maximum Contaminant Level Exceedances						
NJ0105323	ST MARYS SCHOOL - OLD WELL	NITRATE (1040)	MCL, AVERAGE (02)	10/1/2023	12/31/2023	10/25/2023
NJ0105333	CAPPUCCIOS EASTSIDE DELI	NITRATE (1040)	MCL, SINGLE SAMPLE (01)	4/1/2023	6/30/2023	9/19/2023
NJ0123300	WEYMOUTH TWP ELEM SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0123300	WEYMOUTH TWP ELEM SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0123300	WEYMOUTH TWP ELEM SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0318309	2835 ROUTE 206	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	2/1/2024
NJ0336310	WHARTON STATE FOREST BATONA TRAIL CAMP	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	8/1/2023	8/31/2023	
NJ0435309	ARCHWAY ADMINISTRATION	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0435309	ARCHWAY ADMINISTRATION	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0435309	ARCHWAY ADMINISTRATION	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0435309	ARCHWAY ADMINISTRATION	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0435309	ARCHWAY ADMINISTRATION	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0511353	LIBERTY COCA-COLA BEVERAGE LLC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0511353	LIBERTY COCA-COLA BEVERAGE LLC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0603308	F & S PRODUCE - PLANT 1	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ0603308	F & S PRODUCE - PLANT 1	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	10/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0603308	F & S PRODUCE - PLANT 1	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0603308	F & S PRODUCE - PLANT 1	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0603311	EL TIANGUIS	NITRATE (1040)	MCL, AVERAGE (02)	4/1/2023	6/30/2023	10/18/2023
NJ0603331	QIS INC.	NITRATE (1040)	MCL, AVERAGE (02)	1/1/2023	12/31/2023	7/24/2023
NJ0608300	MYRON POWELL ELEMENTARY SCHOOL	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ0608300	MYRON POWELL ELEMENTARY SCHOOL	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ0811900	LASTING LEGACY ACADEMY LLC	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	1/1/2023	3/31/2023	9/27/2023
NJ0811900	LASTING LEGACY ACADEMY LLC	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	1/1/2023	3/31/2023	9/27/2023
NJ0811900	LASTING LEGACY ACADEMY LLC	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	4/1/2023	6/30/2023	9/27/2023
NJ1007305	BRUNELLO TRATTORIA	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	6/1/2023	6/30/2023	
NJ1016300	KINGWOOD TOWNSHIP SCHOOL	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	1/17/2024
NJ1016300	KINGWOOD TOWNSHIP SCHOOL	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	1/17/2024

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1021386	H & R MANAGEMENT INC	TETRACHLOROETHYLENE (2987)	NJ MCL (MC)	1/1/2023	3/31/2023	12/7/2023
NJ1021386	H & R MANAGEMENT INC	TETRACHLOROETHYLENE (2987)	NJ MCL (MC)	4/1/2023	6/30/2023	12/7/2023
NJ1021435	FLEMINGTON NJ MOTOR VEHICLE COMMISSION	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	12/19/2023
NJ1022332	YMCA DEER PATH PARK	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	10/12/2023
NJ1025326	MOUNTAIN VIEW 78	NITRATE (1040)	MCL, AVERAGE (02)	1/1/2023	3/31/2023	
NJ1026302	SOUTH HUNTERDON REGIONAL HS	COMBINED URANIUM (4006)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1026302	SOUTH HUNTERDON REGIONAL HS	COMBINED URANIUM (4006)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1106316	BEAR TAVERN SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	2/7/2024
NJ1106316	BEAR TAVERN SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	2/7/2024
NJ1106316	BEAR TAVERN SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	2/7/2024

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1106367	ST GEORGE R C CHURCH	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	6/1/2023	6/30/2023	8/4/2023
NJ1332356	REMMINGTONS	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	1/1/2023	3/31/2023	
NJ1407301	DICKERSON ELEMENTARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	9/16/2023
NJ1407301	DICKERSON ELEMENTARY SCHOOL	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	9/16/2023
NJ1407301	DICKERSON ELEMENTARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	9/16/2023
NJ1407301	DICKERSON ELEMENTARY SCHOOL	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	9/16/2023
NJ1407301	DICKERSON ELEMENTARY SCHOOL	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	9/16/2023
NJ1407301	DICKERSON ELEMENTARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	9/16/2023
NJ1407336	ALSTEDE FARMS - HOUSE & FARM	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	8/1/2023	8/31/2023	10/26/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1414303	WINDLASS LAKE	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1427383	JOHNSON DODGE CHRYSLER JEEP	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	9/15/2023
NJ1427420	HUNKELE EQUITIES	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	10/10/2023
NJ1427420	HUNKELE EQUITIES	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	10/10/2023
NJ1432354	GODDARD SCHOOL	COMBINED RADIUM (-226 & -228) (4010)	NJ MCL (MC)	4/1/2023	6/30/2023	1/18/2024
NJ1432354	GODDARD SCHOOL	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (MC)	4/1/2023	6/30/2023	1/18/2024
NJ1435318	ROCKAWAY TWP GARAGE	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (NJ)	4/1/2023	6/30/2023	8/11/2023
NJ1435318	ROCKAWAY TWP GARAGE	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (NJ)	7/1/2023	9/30/2023	
NJ1435318	ROCKAWAY TWP GARAGE	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	8/11/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1435318	ROCKAWAY TWP GARAGE	GROSS ALPHA, EXCL. RADON & U (4000)	NJ MCL (NJ)	10/1/2023	12/31/2023	
NJ1514362	CONGREGATION VORKA EDUCATION CENTER	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	7/1/2023	9/30/2023	
NJ1514362	CONGREGATION VORKA EDUCATION CENTER	GROSS ALPHA, EXCL. RADON & U (4000)	MCL, AVERAGE (02)	10/1/2023	12/31/2023	
NJ1611317	CHRIST THE KING LUTHERAN CHURC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1611317	CHRIST THE KING LUTHERAN CHURC	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1615307	MCDONALDS RESTAURANT	COMBINED URANIUM (4006)	MCL, AVERAGE (02)	10/1/2023	12/31/2023	
NJ1805312	FOX HOLLOW GC (CLUB HOUSE	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	11/1/2023	11/30/2023	
NJ1808372	GRIGGSTOWN REFORMED CHURCH	ARSENIC (1005)	NJ MCL (MC)	4/1/2023	6/30/2023	12/26/2023
NJ1808372	GRIGGSTOWN REFORMED CHURCH	ARSENIC (1005)	NJ MCL (MC)	7/1/2023	9/30/2023	2/26/2024
NJ1808372	GRIGGSTOWN REFORMED CHURCH	ARSENIC (1005)	NJ MCL (MC)	10/1/2023	12/31/2023	2/26/2024
NJ1810349	CHERRY BLOSSOM-MONTESSORI SCH	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	7/20/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1810350	HILLSBOROUGH MEDICAL BUILDING	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	12/8/2023
NJ1810350	HILLSBOROUGH MEDICAL BUILDING	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	12/8/2023
NJ1810350	HILLSBOROUGH MEDICAL BUILDING	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	12/8/2023
NJ1810350	HILLSBOROUGH MEDICAL BUILDING	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	12/8/2023
NJ1813310	BLAWENBURG REF CHURCH	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1904320	WILD WEST CITY	TETRACHLOROETHYLENE (2987)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1904320	WILD WEST CITY	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	10/1/2023	10/31/2023	12/6/2023
NJ1904320	WILD WEST CITY	TETRACHLOROETHYLENE (2987)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1904452	CAMP SOMERS	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	8/17/2023
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANOIC ACID (PFOA) (2806)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1905301	HOMESTEAD REHAB AND HEALTH CARE CENTER	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ1905315	BRANCHVILLE BAGEL INC	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	8/23/2023
NJ1908314	LAKE TRANQUILITY COMM CLUB HSE	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	8/30/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1910347	AUDI VOLKSWAGEN OF NEWTON	NITRATE (1040)	MCL, AVERAGE (02)	7/1/2023	9/30/2023	
NJ1910347	AUDI VOLKSWAGEN OF NEWTON	NITRATE (1040)	MCL, AVERAGE (02)	10/1/2023	12/31/2023	
NJ1922300	WALNUT RIDGE PRIMARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	1/1/2023	3/31/2023	
NJ1922300	WALNUT RIDGE PRIMARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	4/1/2023	6/30/2023	
NJ1922300	WALNUT RIDGE PRIMARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	7/1/2023	9/30/2023	
NJ1922300	WALNUT RIDGE PRIMARY SCHOOL	PERFLUOROCTANE SULFONIC ACID (PFOS) (2805)	NJ MCL (MC)	10/1/2023	12/31/2023	
NJ2104311	FOUNTAIN MALL	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	9/28/2023
NJ2104311	FOUNTAIN MALL	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	11/1/2023	11/30/2023	
NJ2113307	BUTCHER'S GRILL -COLUMBIA	E. COLI (3014)	MCL, E. COLI, POS E COLI (RTCR) (1A)	7/1/2023	7/31/2023	1/17/2024
NJ2122331	MOBIL/7-ELEVEN	NITRATE (1040)	MCL, SINGLE SAMPLE (01)	1/1/2023	3/31/2023	7/17/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ2122331	MOBIL/7-ELEVEN	NITRATE (1040)	MCL, AVERAGE (02)	4/1/2023	6/30/2023	7/17/2023
<i>Treatment Technique Violations</i>						
NJ0105323	ST MARYS SCHOOL - OLD WELL	NITRATE (1040)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	10/1/2023	12/31/2023	10/25/2023
NJ0105333	CAPPUCCIOS EASTSIDE DELI	NITRATE (1040)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	9/19/2023
NJ0105350	MARTIN LUTHER KING CENTER	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	1/1/2024
NJ0108334	STORYBOOK LAND - MAIN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ0108386	SOMERSET COVE MARINE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/25/2023		
NJ0108386	SOMERSET COVE MARINE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/11/2023	
NJ0108420	STORYBOOK LAND - BATHROOM	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	12/7/2023		
NJ0108420	STORYBOOK LAND - BATHROOM	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0111353	A-1 MOTEL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/22/2023		
NJ0111423	SWAN LAKE RESORT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/2/2023		
NJ0111441	SMITHVILLE PROFESSIONAL CENTER	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0112312	THE HOTT SPOT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	2/10/2017	7/31/2023	7/31/2023
NJ0112331	CUSTARD CASTLE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/11/2023	
NJ0112363	LAKE LENAPE CAMPGROUND	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	3/15/2023	7/11/2023	5/23/2023
NJ0117317	THE RIVERDECK AT SWEETWATER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ0120306	RED WING LAKES CG-WELL #	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/11/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0120315	RED WING LAKES CG-WELL2-REAR	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/11/2023	
NJ0120317	RED WING LAKES CG-WELL4-FRT 3	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/11/2023	
NJ0212301	CANDLEWYCK DINER	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	12/7/2022	6/5/2023	6/5/2023
NJ0212301	CANDLEWYCK DINER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	CORRECTIVE/EXPEDITED ACTIONS (RTCR) (2C)	12/14/2022	4/3/2023	4/3/2023
NJ0238300	NEW MILFORD SWIM CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/30/2023		
NJ0258308	SADDLE RIVER INN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	2/25/2023	9/20/2023	9/20/2023
NJ0301305	BASS RIVER ST PK-BEACH C	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/16/2023		
NJ0301321	ST PAULS UNITED METHODIST CHURCH	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/22/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0313312	CHARTWELL SWIM CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/29/2023		
NJ0318309	2835 ROUTE 206	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, MCL TRIGGERED (RTCR) (2B)	8/11/2023		
NJ0325301	7-11	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/13/2016	7/31/2023	7/31/2023
NJ0326324	BRG GEN WM C DOYLE CEMETERY ADMIN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/1/2022	1/12/2023	1/12/2023
NJ0333306	RED LION MOTEL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	7/1/2023		
NJ0333322	RED TOP FARM MARKET	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/14/2023		
NJ0335316	DELANCO CAMP MEETING/KITCHEN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/18/2023	
NJ0335317	DELANCO CAMP MEETING/MOTEL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/18/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0335318	DELANCO CAMP MEETING/BOY	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/18/2023	
NJ0335319	DELANCO CAMP MEETING/GIRLS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/1/2023	4/18/2023	
NJ0336301	BATSTO VISTOR CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	2/12/2023	4/3/2023	
NJ0336301	BATSTO VISTOR CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	CORRECTIVE/EXPEDITED ACTIONS (RTCR) (2C)	9/2/2023		
NJ0336301	BATSTO VISTOR CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	10/17/2023	11/19/2023	
NJ0336305	HAWKINS BRIDGE-WHARTON	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/3/2022	9/13/2023	9/13/2023
NJ0336310	WHARTON STATE FOREST BATONA TRAIL CAMP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	10/3/2023	11/27/2023	
NJ0336313	BEL HAVEN CAMPGROUND-(MA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/16/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0336314	BEL HAVEN CAMPGROUND-SEC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/15/2023	4/19/2023	
NJ0336315	BEL HAVEN CAMPGROUND - C	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/16/2023		
NJ0336316	BEL HAVEN CG-SECTION F	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/16/2023		
NJ0418300	HADDON GLEN SWIM CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/29/2023		
NJ0427300	PAPA JOHNS PIZZA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/27/2023		
NJ0436470	GREAT TIMES DAY CAMP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/28/2023		
NJ0436481	DONIO TRUCKING	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	11/6/2020	5/16/2023	5/16/2023
NJ0436490	WINSLOW GOLF CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/2/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0505349	MILL CREEK MARINA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/16/2023	4/25/2023	
NJ0505350	BREE-ZEE-LEE MARINA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/16/2022	4/11/2023	4/11/2023
NJ0505391	HARBORVIEW MARINA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ0505406	CAPE MAY NATL GOLF CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	2/14/2023	2/28/2023	9/21/2023
NJ0506339	OLD STAGECOACH CG-WELLS 1 & 2	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ0511317	OCEAN CITY CAMPGROUND AND BEACH CABINS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/18/2022	3/28/2023	3/28/2023
NJ0511353	LIBERTY COCA-COLA BEVERAGE LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/23/2022	3/9/2023	3/9/2023
NJ0511355	SEAVILLE TAVERN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/8/2022	2/3/2023	2/3/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0511355	SEAVILLE TAVERN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/8/2022	2/3/2023	3/9/2023
NJ0511384	SEAVILLE SHORES CAMPGROUND	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ0511396	MCDONALDS OF SEAVILLE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/12/2023		
NJ0602316	NEWCOMBS MARKET	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	5/11/2023	5/25/2023	5/25/2023
NJ0602319	DOLLAR GENERAL #13854	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/16/2023		
NJ0603308	F & S PRODUCE - PLANT 1	GROSS ALPHA, EXCL. RADON & U (4000)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	COMBINED URANIUM (4006)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	COMBINED RADIUM (-226 & -228) (4010)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	RADIUM-226 (4020)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0603308	F & S PRODUCE - PLANT 1	RADIUM-228 (4030)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	
NJ0603308	F & S PRODUCE - PLANT 1	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	
NJ0603308	F & S PRODUCE - PLANT 1	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	12/31/2023
NJ0603331	QIS INC.	NITRATE (1040)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	12/31/2023	7/24/2023
NJ0605318	MISS INEZ CHILDRENS HOUSE II	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	11/12/2023		
NJ0605323	FAIRFIELD TOWNSHIP SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0607311	DEVEROUX FOUNDATION	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	7/1/2023	9/30/2023	11/21/2023
NJ0607325	GEORGETOWN SWIM CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/10/2023		
NJ0609300	MAUR RIV TWP BD OF ED PO	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ0609320	GEORGES PIZZA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/4/2022	3/2/2023	3/2/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0610314	CUSTARD CORAL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/10/2023	4/10/2023	
NJ0613307	SEABROOK HOUSE	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0613308	RED BARN DELI, THE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/7/2023	12/11/2023	12/11/2023
NJ0804317	LAKE GARRISON INC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/30/2023		
NJ0804329	LAKE GARRISON RESTROOMS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/30/2023		
NJ0805303	CAROLINE REUTTER SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ0805303	CAROLINE REUTTER SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ0805426	MARY F JANVIER SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ0805426	MARY F JANVIER SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ0805440	FRANKLIN TWP BOE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	7/27/2023		
NJ0805440	FRANKLIN TWP BOE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/17/2023		
NJ0805440	FRANKLIN TWP BOE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	10/15/2023		
NJ0805456	TONIS TREATS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/21/2023		
NJ0808317	GODDARD SCHOOL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	7/27/2023		
NJ0811353	JEHOVAHS WITNESS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/28/2023		
NJ0811405	WAWA #379	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	8/1/2023		
NJ0816304	STEWART MEMORIAL PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/5/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1006301	WINNEWALD DAY CAMP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	7/27/2023		
NJ1006313	ROUND VALLEY STATE PARK REC AREA NORTH W	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/19/2023		
NJ1007305	BRUNELLO TRATTORIA	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	11/9/2023		
NJ1007305	BRUNELLO TRATTORIA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/28/2023		
NJ1008300	DOVES RCH	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1019309	HOFFMANS CROSSING SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1019322	WOODGLEN SCHOOL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	2/7/2023		
NJ1019334	TONYS BISTRO	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	5/7/2023		
NJ1019334	TONYS BISTRO	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	7/27/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1019334	TONYS BISTRO	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/28/2023		
NJ1021435	FLEMINGTON NJ MOTOR VEHICLE COMMISSION	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	11/9/2022	12/19/2023	12/19/2023
NJ1022316	HILLCREST PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ1022318	WHITEHOUSE MOTEL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	1/10/2023		
NJ1022341	VERANO NJ	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	6/15/2023		
NJ1022378	SUMMER ROAD PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ1022381	CORNHUSKERS PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ1024304	BRADY FOUNDATION LIFECAMP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/11/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1025300	STATE OF NJ SPRUCE RUN RECREAT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/30/2022	3/14/2023	3/14/2023
NJ1025326	MOUNTAIN VIEW 78	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	8/3/2023	11/22/2023	11/22/2023
NJ1025331	UNION TOWNSHIP ELEM SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1106316	BEAR TAVERN SCHOOL	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	10/3/2023
NJ1106335	WASHINGTON CROSSING STATE PK DAY USE TRL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/11/2023		
NJ1106399	CORNER STONE COURT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	2/27/2023	2/27/2023	2/27/2023
NJ1113307	EDEN AUTISM CLAYTON CENTER	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1309432	COLTS NECK STILLHOUSE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	4/2/2023		
NJ1319436	CAMP SACAJAWEA-TRAILER W	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/19/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1326313	MONMOUTH HEIGHTS SHELL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	11/10/2023		
NJ1326313	MONMOUTH HEIGHTS SHELL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/2/2023		
NJ1326379	QUICK CHEK STORE #178	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/2/2023		
NJ1332301	MILLSTONE TWP ELEMENTARY SCHOOL	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	11/12/2023		
NJ1332324	GREIF BROTHERS INC	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1332324	GREIF BROTHERS INC	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1332326	MILLSTONE PROFESSIONAL PLAZA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/31/2022	3/21/2023	3/21/2023
NJ1332329	GEDI CORPORATE PLAZA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	CORRECTIVE/EXPEDITED ACTIONS (RTCR) (2C)	2/19/2023	4/3/2023	4/3/2023
NJ1332356	REMMINGTONS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, MCL TRIGGERED (RTCR) (2B)	2/25/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1332366	CITGO MART & DELI	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/1/2023		
NJ1332391	BLACK BEAR DAY CAMP WELL 3	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/21/2023		
NJ1351325	NJ CHRISTIAN ACADEMY GYM	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/23/2022	1/9/2023	4/11/2024
NJ1407301	DICKERSON ELEMENTARY SCHOOL	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	7/7/2022	9/16/2023	9/16/2023
NJ1407301	DICKERSON ELEMENTARY SCHOOL	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	10/5/2022	9/16/2023	9/16/2023
NJ1407303	BLACK RIVER MIDDLE SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	10/6/2023
NJ1407313	AP CHESTER PROPERTIES LLC	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1407313	AP CHESTER PROPERTIES LLC	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1407332	QUICK-CHEK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/21/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1414302	JEFFERSON HOUSE	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	12/2/2021	5/24/2023	5/24/2023
NJ1414302	JEFFERSON HOUSE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/2/2023		
NJ1414336	SPEEDY MART	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/31/2022	2/28/2023	2/28/2023
NJ1414376	SUN AIR CAMP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	CORRECTIVE/EXPEDITED ACTIONS (RTCR) (2C)	6/15/2023	7/21/2023	7/3/2023
NJ1422301	MORRIS COUNTY GOLF CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023	5/25/2023	5/25/2023
NJ1427302	SANDSHORE SCHOOL	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	5/27/2023		
NJ1427325	PAVILION LOUNGE	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	10/1/2022	10/13/2023	10/13/2023
NJ1427325	PAVILION LOUNGE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	7/28/2022	3/1/2023	3/1/2023
NJ1427383	JOHNSON DODGE CHRYSLER JEEP	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	12/23/2022	9/15/2023	9/15/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1427385	QUIKRETE	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	7/7/2022	1/23/2023	1/23/2023
NJ1427393	FLA-NET CAMPGROUND	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	9/15/2022	1/23/2023	1/23/2023
NJ1427400	SANDSHORE INDUSTRIAL CONDO ASSOCIATION	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1427401	DAYS INN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/14/2022	4/27/2023	4/27/2023
NJ1427420	HUNKELE EQUITIES	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	3/6/2022	7/10/2023	10/10/2023
NJ1432331	LA STRADA RESTAURANT	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/11/2019	2/16/2023	2/16/2023
NJ1432354	GODDARD SCHOOL	GROSS ALPHA, EXCL. RADON & U (4000)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	1/18/2024
NJ1432354	GODDARD SCHOOL	COMBINED URANIUM (4006)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	1/18/2024
NJ1432354	GODDARD SCHOOL	COMBINED RADIUM (-226 & -228) (4010)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	1/18/2024
NJ1432354	GODDARD SCHOOL	RADIUM-226 (4020)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	1/18/2024

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1432354	GODDARD SCHOOL	RADIUM-228 (4030)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	1/18/2024
NJ1432362	RANDOLPH PARK BEACH	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/29/2023	5/4/2023	5/4/2023
NJ1434329	MCWILLIAMS FORGE COMPANY INC	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	11/7/2023		
NJ1435330	CAMP LEWIS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ1435348	CAMP LEWIS-UPPER CAMP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2023		
NJ1436344	PRUDENT PUBLISHING CO	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	4/1/2023	7/11/2023	7/11/2023
NJ1436365	NJDOT @ ROXBURY CORP CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	8/13/2017	7/6/2023	7/6/2023
NJ1438350	OMG BURGER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	6/3/2023	10/12/2023	10/12/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1505324	PUBLIC WORKS BLDG	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	1/1/2023	10/10/2023	10/10/2023
NJ1507390	TR MARINA LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/1/2023	3/16/2023	
NJ1508304	EAGLESWOOD ELEMENTARY SCHOOL	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	8/13/2023	12/21/2023	12/21/2023
NJ1511345	AMERICAN VETS POST 2	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	1/24/2021	6/7/2023	6/7/2023
NJ1511412	JEHOVAH WITNESS CHURCH	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	7/28/2023	12/19/2023	
NJ1514360	MESIVTA OHR CHAIM MEIR	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	2/13/2023		
NJ1516307	BAKERS ACRES CG GREEN HOU WELL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/1/2023		
NJ1516362	KOHR'S ICE CREAM	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/12/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1518316	MARFORI REALTY LLC	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	1/1/2023	7/24/2023	7/24/2023
NJ1615310	TJ'S PIZZERIA CAFE' LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/21/2023		
NJ1615314	MOTIVA - SHELL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/28/2021	3/3/2023	3/3/2023
NJ1615324	MAPLE ROAD ELEMENTARY SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1615325	MACOPIN MIDDLE SCHOOL	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	3/16/2023	7/24/2023	7/24/2023
NJ1615330	PARADISE KNOLL ELEM SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1615330	PARADISE KNOLL ELEM SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1615396	DUNKIN DONUTS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/21/2023		
NJ1615415	DAIRY QUEEN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/6/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1615422	NEWARK WATERSHED CONSERVATION	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	7/6/2023		
NJ1615451	AMERICAN LEGION POST #289	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	3/13/2023		
NJ1615454	HILLCREST BALLFIELD	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/2/2023		
NJ1701303	CAMP THEODORE ROOSEVELT (MESS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/30/2021	4/27/2023	4/27/2023
NJ1701304	CAMP THEODORE ROOSEVELT (CHERO	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	4/7/2023		
NJ1706300	JOHN FENWICK REST STOP	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	3/16/2023	8/1/2023	8/1/2023
NJ1708300	THE CHEMOURS COMPANY FC LLC	IESWTR (0300)	MONTHLY COMB FLTR EFFLUENT (IESWTR/LT1) (44)	12/1/2023	12/31/2023	
NJ1708300	THE CHEMOURS COMPANY FC LLC	IESWTR (0300)	SINGLE COMB FLTR EFFLUENT (IESWTR/LT1) (43)	12/1/2023	12/31/2023	
NJ1709306	FOUR SEASONS CG - #1	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	10/12/2022	6/29/2023	6/29/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1710301	ARTHUR P SCHALICK HIGH S	STATE RULE (SR)	FAILURE TO REMEDIATE MCL WITHIN 1 YEAR (1Y)	3/22/2023	5/4/2023	5/4/2023
NJ1803304	SOMERSET HILLS COUNTRY CLUB	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ1803304	SOMERSET HILLS COUNTRY CLUB	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1805312	FOX HOLLOW GC (CLUB HOUSE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	12/21/2023		
NJ1805373	BRANCHBURG'S SILVER SADDLE COMM POOL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/29/2023		
NJ1805398	SOUTH BRANCH FAMILY PRACTICE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	8/25/2023		
NJ1808372	GRIGGSTOWN REFORMED CHURCH	ARSENIC (1005)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	12/26/2023
NJ1810341	ROYCEFIELD SWIM CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	1/7/2023	5/12/2023	
NJ1810341	ROYCEFIELD SWIM CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	7/2/2023	7/17/2023	

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1818321	LEPP PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/12/2023		
NJ1820306	WATCHUNG HILLS HS-FIELD	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/16/2023		
NJ1820310	WAGNER FARM ARBORETUM	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/2/2020	1/26/2023	1/26/2023
NJ1820310	WAGNER FARM ARBORETUM	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/2/2021	1/26/2023	1/26/2023
NJ1820310	WAGNER FARM ARBORETUM	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/2/2022	1/26/2023	1/26/2023
NJ1902351	CORNER REST T/A GREEKS TAVERN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	8/20/2021	10/13/2023	10/13/2023
NJ1902351	CORNER REST T/A GREEKS TAVERN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	9/9/2022	10/13/2023	10/13/2023
NJ1902351	CORNER REST T/A GREEKS TAVERN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	1/13/2023	10/13/2023	10/13/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1904335	NEWHOUSE BUILDING	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/9/2023	9/10/2023	9/10/2023
NJ1904353	NIELSEN NISSAN	LEAD & COPPER RULE (5000)	OCCT/SOWT RECOMMENDATION/STUDY (LCR) (57)	7/1/2023		
NJ1904361	TOMAHAWK LAKE INC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/22/2023		
NJ1904363	TOMAHAWK LAKE INC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/1/2023	6/28/2023	
NJ1904452	CAMP SOMERS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	7/2/2023		
NJ1905316	JUMBO LAND	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/14/2023		
NJ1905340	SKYLANDS BALL PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	10/2/2023		
NJ1905340	SKYLANDS BALL PARK	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/13/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1905341	NORMANOCH ASSOCIATION	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/29/2023	9/30/2023	7/31/2023
NJ1905355	SUSSEX COUNTY FAIRGROUNDS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	8/23/2023		
NJ1905355	SUSSEX COUNTY FAIRGROUNDS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/2/2023		
NJ1905355	SUSSEX COUNTY FAIRGROUNDS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	8/2/2023		
NJ1908315	TRANQUILITY ADVENTIST SCHOOL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/10/2022	2/15/2023	2/15/2023
NJ1908315	TRANQUILITY ADVENTIST SCHOOL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	1/15/2023	2/15/2023	2/15/2023
NJ1908327	TRANQUILITY FARMS LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	4/2/2023	10/5/2023	10/5/2023
NJ1908327	TRANQUILITY FARMS LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	3/2/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1911345	BALLYOWEN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/16/2023		
NJ1914329	MOUNTAIN TOP RV PARK LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/4/2023		
NJ1917309	STOKES S F - STEAM MILL	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/2/2021	3/28/2023	3/28/2023
NJ1918312	PRINTING CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, MCL TRIGGERED (RTCR) (2B)	10/13/2022	1/17/2023	8/30/2022
NJ1918312	PRINTING CENTER	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	11/30/2022	6/13/2023	6/13/2023
NJ1918312	PRINTING CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/23/2022	1/17/2023	1/17/2023
NJ1918312	PRINTING CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	1/15/2023	1/17/2023	1/17/2023
NJ1920313	MOUNTAIN SHADOWS LAKE I	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/7/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1920317	STILLWATER TWP ELEMENTARY SCHOOL	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ1920324	HYDE AWAY	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, MCL TRIGGERED (RTCR) (2B)	8/10/2022	2/28/2023	2/28/2023
NJ1920324	HYDE AWAY	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	10/28/2022	3/2/2023	3/2/2023
NJ1922353	LAKE WALKILL COMMUNITY	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	5/2/2023		
NJ1922409	HEAVEN HILL FARMS	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/2/2023		
NJ1922412	GREAT GORGE COUNTRY CLUB	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/1/2023	3/15/2023	
NJ1924330	SUSSEX DAIRY QUEEN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/14/2023	7/27/2023	7/27/2023
NJ1924332	CHURCH OF THE GOOD SHEPP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/10/2022	5/23/2023	5/23/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ1924332	CHURCH OF THE GOOD SHEPP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	10/2/2023		
NJ2104307	BLAIRSTOWN DAIRY	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	3/24/2023		
NJ2104311	FOUNTAIN MALL	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	11/26/2023		
NJ2104328	PREMIER HEALTH ASSOCIATES LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, TC POS RT NO RPT (RTCR) (2A)	12/2/2021	11/15/2023	11/15/2023
NJ2104333	WARREN CO LIBRARY-CDH BRANCH	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	9/23/2023	12/19/2023	12/19/2023
NJ2106309	JAMES ALEXANDER CORP	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	2/25/2020	8/3/2023	8/3/2023
NJ2106309	JAMES ALEXANDER CORP	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, MCL TRIGGERED (RTCR) (2B)	8/15/2020	7/19/2023	7/19/2023
NJ2106309	JAMES ALEXANDER CORP	LEAD & COPPER RULE (5000)	OCCT/SOWT INSTALL DEMONSTRATION (LCR) (58)	4/20/2023	10/18/2023	10/18/2023
NJ2109317	WATERGATE PICNIC AREA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/27/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ2110312	HARMONY RECAREA SNACK B	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	1/20/2022	5/2/2023	5/2/2023
NJ2110312	HARMONY RECAREA SNACK B	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/20/2023		
NJ2112325	INDEPENDENCE RECREATION COMPLE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	6/3/2023		
NJ2113309	DEL RIVER FAMILY CMP GRN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	4/9/2023		
NJ2113310	MOBIL TRUCK STOP	GROUNDWATER RULE (0700)	FAILURE TO ADDRESS CONTAMINATION (GWR) (48)	6/2/2017	7/3/2023	10/12/2023
NJ2113311	CHEFS CATERING	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	7/25/2022	3/27/2023	3/27/2023
NJ2113311	CHEFS CATERING	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	9/10/2022	3/27/2023	3/27/2023
NJ2113322	TRAVEL CENTERS OF AMERICA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	6/21/2023	9/14/2023	9/14/2023

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ2113341	KITTATINNY VISITOR CENTER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	STARTUP PROCEDURES TT (RTCR) (2D)	6/2/2022	4/22/2023	4/22/2023
NJ2116307	COUNTRY CORNER STORE & CAFE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	12/10/2022	10/2/2023	10/2/2023
NJ2116307	COUNTRY CORNER STORE & CAFE	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	9/10/2023	10/2/2023	10/2/2023
NJ2122312	MAMMA MARIA	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, TC POS RT NO RPT (RTCR) (2A)	1/14/2023		
NJ2122331	MOBIL/7-ELEVEN	STATE RULE (SR)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	1/1/2023	3/31/2023	
NJ2122331	MOBIL/7-ELEVEN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/3/2022	8/13/2023	8/13/2023
NJ2122331	MOBIL/7-ELEVEN	NITRATE (1040)	FAILURE TO MAINTAIN TREATMENT DEVICE (TD)	4/1/2023	6/30/2023	
NJ2122331	MOBIL/7-ELEVEN	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 2 ASSESSMENT, 2ND LEVEL 1(RTCR) (2B)	11/27/2023		

Public Water System ID Number	Water System Name	Contaminant/Rule: Analyte/Rule (Code)	Violation Type: Name (Code)	Compliance Period Begin Date	Compliance Period End Date	Return to Compliance Date
NJ2122332	297 RT 31 SOUTH LLC	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	10/22/2023		
NJ2123308	WARREN RESIDENTIAL GROUP	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	1/1/2023	6/30/2023	
NJ2123308	WARREN RESIDENTIAL GROUP	LEAD & COPPER RULE (5000)	WQP LEVEL NON-COMPLIANCE (LCR) (59)	7/1/2023	12/31/2023	
NJ2123318	RIVERSIDE DINER	REVISED TOTAL COLIFORM RULE (RTCR) (8000)	LEVEL 1 ASSESS, MULTIPLE TC POS (RTCR) (2A)	2/23/2023		